

PLAN SYMBOLS

	HOME RUN TO PANELBOARD. NO. OF ARROWS INDICATE NO. OF CIRCUITS, HASH MARKS INDICATE NO. OF #12 AWG. CONDUCTORS. NO HASH MARKS INDICATE 2 #12 CONDUCTORS.
	CONDUIT CONCEALED IN WALL, IN SLAB ABOVE, OR ABOVE CEILING
	CONDUIT CONCEALED IN OR BELOW FLOOR OR UNDERGROUND.
	CONDUIT RUN EXPOSED. RUN PARALLEL OR PERPENDICULAR TO STRUCTURE OR WALL.
	FLEXIBLE CONDUIT WITH EQUIPMENT CONNECTION.
	CONCRETE ENCASED DUCTBANK.
	CEILING MOUNTED LIGHTING FIXTURE, LETTER INDICATES TYPE (TYPICAL).
	WALL MOUNTED LIGHTING FIXTURE.
	FLUORESCENT LIGHTING FIXTURE, CEILING MOUNTED.
	EXTERIOR LUMINAIRE AND MOUNTING STANDARD.
	EXISTING EXTERIOR LIGHTING
	EMERGENCY BATTERY PACK LIGHTING FIXTURE.
	JUNCTION BOX N.E.C. SURFACE MOUNTED UNLESS INDICATED OTHERWISE.
	JUNCTION BOX PER N.E.C., FLUSH MOUNTED UNLESS INDICATED OTHERWISE.
	FLUSH OR SURFACE MOUNTED LIGHTING PANELBOARD.
	FLUSH OR SURFACE MOUNTED POWER PANELBOARD.
	DRY TYPE TRANSFORMER. NO. INDICATES KVA RATING.
	90A, 208V, 1Ø WELDING OUTLET
	20A, 125V, 3W DUPLEX RECEPTACLE IN FLUSH OUTLET BOX, 18" ABOVE FINISHED FLOOR.
	20A, 125V, 3W DUPLEX RECEPTACLE IN FLUSH OUTLET BOX, 48" ABOVE FINISHED FLOOR OR 2" ABOVE COUNTER AS REQUIRED.
	20A, 125V, 3W DUPLEX RECEPTACLE IN FLUSH, FLOOR MOUNTED OUTLET BOX.
	20A, 125V, 3W DUPLEX RECEPTACLE, SURFACE MOUNTED.
	DISCONNECT RACK MOUNTED
	HOA/DISCONNECT RACK MOUNTED
	30A, 250V 1Ø, 3W SINGLE RECEPTACLE IN FLUSH OUTLET BOX, 18" ABOVE FINISHED FLOOR.
	SINGLE POLE SWITCH IN FLUSH OUTLET BOX, 48" ABOVE FINISHED FLOOR, UNLESS OTHERWISE NOTED (TYPICAL).
	SINGLE POLE SWITCH, SURFACE MOUNTED.
	THREE-WAY SWITCH IN FLUSH OUTLET BOX.
	MOTOR DUTY, SINGLE PHASE DISCONNECT, NEMA 4X STAINLESS STEEL
	NON-FUSIBLE DISCONNECT SWITCH, 30A,3P UNLESS OTHERWISE INDICATED.
	NON-FUSIBLE DISCONNECT SWITCH, 30A,3P UNLESS OTHERWISE INDICATED, WITH REMOTE CONTROL STATION AS REQUIRED BY ELEMENTARY DIAGRAMS OR SPECS
	ELECTRIC A.C. MOTOR, NO. INDICATES HORSEPOWER.
	FUSED DISCONNECT SWITCH (30/20: 30=SWITCH RATING, 20=FUSE RATING)
	MOTORIZED VALVE
	COMBINATION MOTOR STARTER
	VARIABLE FREQUENCY DRIVE
	THERMOSTAT
	ELECTRIC HEATER
	FLUSH OUTLET BOX AND TELEPHONE COVER PLATE 48" ABOVE FINISHED FLOOR.
	CONTROL PULLBOX. SEE "PULL BOX DETAIL"
	POWER MANHOLE. SEE "MANHOLE DETAIL"
	TERMINATION CABINET, CLASS 1, DIVISION 2
	EYS FITTING AND CORRESPONDING "CHICO" CEMENT. COMBINATION SHALL BE RATED TO PROVIDE A CLASS 1, DIVISION 2 INSTALLATION.
	MAJOR COMPONENT, X COMPONENT NUMBER
	NAMEPLATE SCHEDULE

PLAN SYMBOLS (CONTINUED)

	ANALYZING INDICATING TRANSMITTER
	FLOW ELEMENT
	LEVEL SWITCH
	LEVEL ELEMENT
	PRESSURE SWITCH
	ZERO SPEED SWITCH
	SOLENOID VALVE
	LIQUID LEVEL SWITCH
	FLOW SWITCH
	FLOW INDICATING TRANSMITTER
	LEVEL INDICATING TRANSMITTER

SINGLE LINE DIAGRAM SYMBOLS

	COMBINATION MOTOR STARTER
	VOLTMETER
	AMMETER
	THREE PHASE VOLT SWITCH
	THREE PHASE AMP SWITCH
	GROUND FAULT INTERRUPTER
	WATT HOUR METER
	CAPACITOR
	DRAW-OUT CIRCUIT BREAKER
	MOLDED CASE CIRCUIT BREAKER
	TYPICAL SELECTOR SWITCH AND CONTROL. SEE ELEMENTARY DIAGRAMS FOR EXACT TYPE.
	ELECTRIC A.C. MOTOR, NO. INDICATES HORSEPOWER.
	ELECTRIC D.C. MOTOR, NO. INDICATES HORSEPOWER.
	SERVICE OR EQUIPMENT GROUND.
	NON-FUSIBLE DISCONNECT SWITCH, 30A,3P UNLESS OTHERWISE INDICATED.
	NON-FUSIBLE DISCONNECT SWITCH, 30A,3P UNLESS OTHERWISE INDICATED, WITH REMOTE CONTROL STATION AS REQUIRED BY ELEMENTARY DIAGRAMS OR SPECS
	LIGHTING PANELBOARD
	POWER PANELBOARD
	KIRK KEY INTERLOCK
	CURRENT TRANSFORMERS
	POTENTIAL TRANSFORMERS
	MANUAL OR AUTOMATIC TRANSFER SWITCH

CONTROL DIAGRAM SYMBOLS

	DUPLEX RECEPTACLE
	NORMALLY OPEN CONTACT
	NORMALLY CLOSED CONTACT
	LIMIT SWITCH, NORMALLY OPEN
	LIMIT SWITCH, NORMALLY CLOSED
	PRESSURE SWITCH, NORMALLY OPEN
	PRESSURE SWITCH, NORMALLY CLOSED
	FLOAT SWITCH, NORMALLY OPEN
	FLOAT SWITCH, NORMALLY CLOSED

CONTROL DIAGRAM SYMBOLS (CONTINUED)

	FLOW SWITCH, NORMALLY OPEN
	FLOW SWITCH, NORMALLY CLOSED
	TEMPERATURE SWITCH, NORMALLY OPEN
	TEMPERATURE SWITCH, NORMALLY CLOSED
	NORMALLY OPEN, TIMED TO CLOSE CONTACT
	NORMALLY CLOSED, TIMED TO OPEN CONTACT
	NORMALLY CLOSED, TIMED TO CLOSE CONTACT
	NORMALLY OPEN, TIMED TO OPEN CONTACT
	LIMIT SWITCH
	TORQUE SWITCH
	PRESSURE SWITCH
	ZERO SPEED SWITCH
	SOLENOID VALVE
	LIQUID LEVEL SWITCH
	VIBRATION SWITCH
	ALARM RELAY
	ALARM TIMER
	CONTROL RELAY
	MOTOR STARTER
	TIMING RELAY
	ALARM INDICATING LIGHT
	RUN INDICATING LIGHT
	MOMENTARY CONTACT PUSHBUTTON
	MOMENTARY BREAK PUSHBUTTON OR RESET
	KEYED SWITCH
	MAINTAINED CONTACT ON-OFF SWITCH
	START/STOP (S/S) CONTROL SWITCH MAINTAINED CONTACT
	THREE POSITION MAINTAINED CONTACT SELECTOR SWITCH
	FUSE
	MOLDED CASE CIRCUIT BREAKER
	CONTROL POWER TRANSFORMER
	REMOTE TERMINAL BLOCK POINT
	HORN

ABBREVIATIONS

A	AMPERES
ACCU	AIR COOLED CONDENSING UNIT
AFF	ABOVE FINISHED FLOOR
AHU	AIR HANDLING UNIT
AIC	AMPS INTERRUPTING CURRENT
AER	AERATOR
ATS	AUTOMATIC TRANSFER SWITCH
BKR	BREAKER
BLDG	BUILDING
C	CONDUIT
CLB	CURRENT LIMITING BREAKER
CP	CONTROL PANEL
CU	COPPER
DH	DATA HIGHWAY
DISC	DISCONNECT
DO	DIGITAL OUTPUT
DPDT	DOUBLE POLE DOUBLE THROW
DPST	DOUBLE POLE SINGLE THROW
EFF	EFFLUENT
ELEC	ELECTRICAL
ELR	EMERGENCY LOCK-OUT RELAY
EM	EMERGENCY
ENCL	ENCLOSURE
EP	EXPLOSION PROOF
ESB	ENERGY SAVING BALLAST
ETM	ELAPSED TIME METER
EUH	ELECTRIC UNIT HEATER

ABBREVIATIONS (CONTINUED)

EVA	ELECTRIC VALVE ACTUATOR
EXH	EXHAUST
EXIST	EXISTING
F&I	FINISH AND INSTALL
FPL	FLORIDA POWER AND LIGHT
FVNR	FULL VOLTAGE NON-REVERSING
GEN	GENERATOR
GFI	GROUND FAULT INTERRUPTER
GND, G	GROUND
GRS	GALVANIZED RIGID STEEL
HOA	HAND-OFF-AUTOMATIC
HOLR	HAND-OFF-LOCAL-REMOTE
HOR	HAND-OFF-REMOTE
HP	HORSEPOWER
HPS	HIGH PRESSURE SODIUM
HWY	HIGHWAY
INSTR	INSTRUMENTATION
IPS	INFLUENT PUMP STATION
KVA	KILOVOLT-AMPERES
KW	KILOWATT
LTG	LIGHTING
MAX	MAXIMUM
MCC	MOTOR CONTROL CENTER
MFR	MANUFACTURER
MH	METAL HALIDE
MIN	MINIMUM
MLO	MAIN LUGS ONLY
MSC	MANUFACTURER SUPPLIED CABLE
MTD	MOUNTED
MTS	MANUAL TRANSFER SWITCH
MV	MERCURY VAPOR
NEC	NATIONAL ELECTRIC CODE
NEUT, N	NEUTRAL
NTS	NOT TO SCALE
OC	ON CENTER
OH	OVERHEAD
P	POLE
PC	PHOTOCELL
PCP	PUMP CONTROL PANEL
PE	POWER EQUIPMENT
PM	PHASE MONITOR
PNL	PANEL
PS	PUMP STATION
PVC	POLYVINYL CHLORIDE
RA	RIGID ALUMINUM
RECP	RECEPTACLE
RTU	REMOTE TELEMETRY UNIT
RVNR	REDUCED VOLTAGE NON-REVERSING
SH	SHIELDED
SS	STAINLESS STEEL
STP	SHIELDED TWISTED PAIR
STR	STARTER
SUPP	SUPPRESSOR
SW	SWITCH
SWGR	SWITCHGEAR
TBR	TO BE REMOVED
TD	TIME DELAY
TR	TRANSFORMER
TYP	TYPICAL
UG	UNDERGROUND
UON	UNLESS OTHERWISE NOTED
UPS	UNINTERRUPTABLE POWER SUPPLY
UV	ULTRAVIOLET
V	VOLT
VFD	VARIABLE FREQUENCY DRIVE
W	WATT
W/	WITH
WP	WEATHERPROOF
Ø	PHASE

NOTES

- ALL WORK SHALL COMPLY WITH N.E.C. AND LOCAL CODES.
- CONDUCTORS SHALL NOT BE SPLICED EXCEPT AS NOTED IN SPECS.
- ALL CONTROL PANELS SHALL BE UL LISTED.
- THESE DRAWINGS ARE INTENDED TO SHOW STANDARDS ON NEW PUMP STATIONS. AT THE COUNTY'S DISCRETION REHABS AND RENOVATIONS MAY HAVE DIFFERING DETAILS ON A SITE BY SITE BASIS.

REVNO.	DESCRIPTIONS	DATE
2	REVISED TO INCORPORATE FIELD CHANGES	8/26/15
1	CONFIRMED	5/17/13
REVISIONS	REVISIONS	

SEAL

SEAL


SEAL

HILLSBOROUGH COUNTY
PUBLIC UTILITIES
ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5977

DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

ELECTRICAL SYMBOLS, NOTES,
AND ABBREVIATIONS





DATE: OCTOBER 2011	SCALE	FILE NUMBER
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER
DRAWN	VERTICAL:	E-0.0
DESIGNED	NA	
CHECKED		
PROJ. MGR.		
STATUS: REVISED	REVISION	2

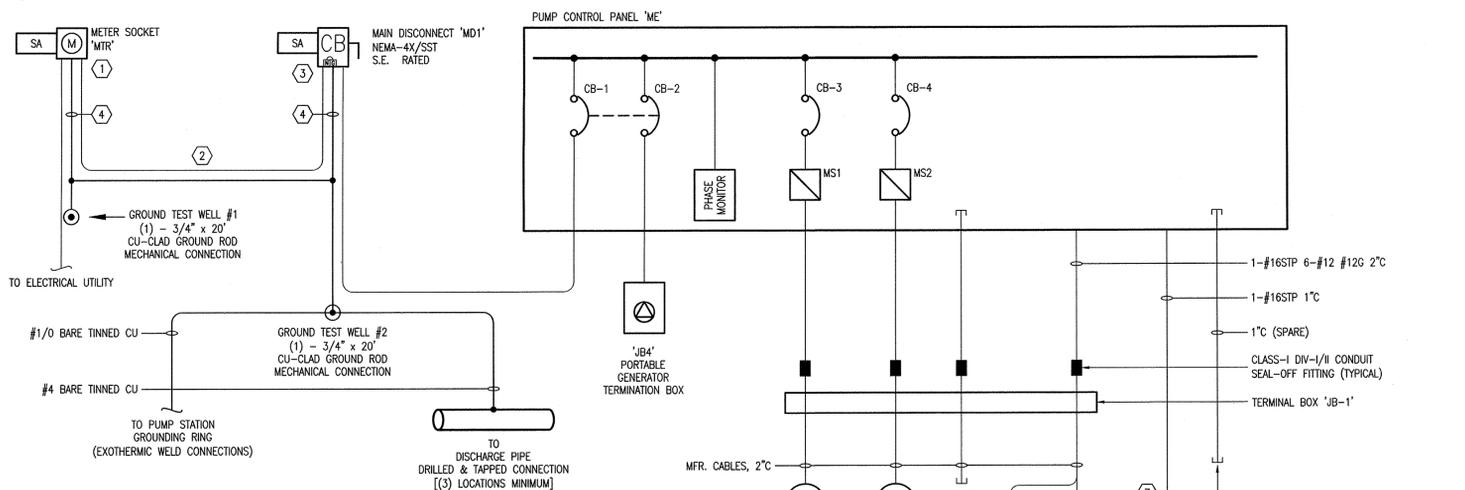


480VAC LOAD CALCULATIONS				
DESCRIPTION				AMPERES
PUMP NO.1	___HP	480VAC	3-φ	___AMPS
PUMP NO.2	___HP	480VAC	3-φ	___AMPS
MOTOR SUB TOTAL:				___AMPS
25% OF LARGEST MOTOR:				___AMPS
TOTAL MOTOR LOAD:				___AMPS
ODOR CONTROL SYSTEM (FUTURE)	1200W	480VAC	3-φ	2.5
TRANSFORMER	3KVA	480VAC	3-φ	6.25
TOTAL MAXIMUM PHASE AMPERES:				___AMPS
SERVICE SIZE: ___A, 480VAC, 3φ, 4-WIRE, MINIMUM				

- KEYNOTES:**
- ELECTRICAL CONTRACTOR SHALL COORDINATE WITH TECO FOR METERING REQUIREMENTS AND SERVICE CONSTRUCTION STANDARDS (SESR-2010). WIRE IDENTIFICATION AND PHASE ARRANGEMENT SHALL BE PER NEC.
 - EQUIPMENT AND WIRE SHALL BE SIZED AND RATED ACCORDING TO THE SERVICE VOLTAGE AND RESPECTIVE PUMP SIZES AT THE STATION. REFER TO CROSS REFERENCE TABLE ON DRAWING E-1.2.
 - MD1, CB1 THRU CB5, AND CB10 SHALL BE CAPABLE OF INTERRUPTING A FAULT CURRENT OF 25,000 AIC MINIMUM.
 - REFER TO WIRE SIZE CHART E-1.2. FOR USE WITH UNGROUNDED CONDUCTORS:
• 3/0 OR SMALLER --> #4G
• OVER 3/0 THRU 350 --> #2G
• OVER 350 THRU 600 --> 1/0G
INSTALL IN 3/4" PVC SCH-80.
 - ROUND OVER AND GRIND ALL EDGES SMOOTH TO PROTECT PERSONNEL FROM POTENTIAL INJURY.
 - ALARM STROBE SHALL BE MOUNTED 18" MINIMUM ABOVE TOP OF SURROUNDING FENCE.
 - CONTRACTOR SHALL COORDINATE INSTALLATION WITH ENGINEER/HCPU.
 - TELECOM SERVICE CONNECTION WILL BE PROVIDED ON A CASE BY CASE BASIS CONTRACTOR TO COORDINATE WITH HCPU.
 - RACK-MOUNT POWER RECEPTACLE. LOCATE AT EQUIPMENT RACK SUPPORT POST (FACING TO FRONT) AND ADJACENT TO "ME" CABINET.

- GENERAL NOTES:**
- ALL ELECTRICAL WORK SHALL COMPLY WITH THE NEC, NESC AND LOCAL CODES INCLUDING OWNERS STANDARDS AND REQUIREMENTS.
 - ALL POWER & CONTROL CONDUCTORS SHALL BE 600V RATED THHN/THWN-2 STRANDED CU AND SIZED PER NEC.
 - ALL EXPOSED CONDUITS SHALL BE ALUMINUM THRU FIRST UNDERGROUND 90° BEND. WHERE IN CONTACT WITH CONCRETE SLAB, FIRST UNDERGROUND CONDUIT SHALL BE COATED USING BITUMINOUS PAINT.
 - ALL UNDERGROUND CONDUITS SHALL BE PVC SCH-80.
 - ALL MECHANICAL CONNECTIONS SHALL BE THROUGH-BOLTED MADE WITH STAINLESS STEEL HARDWARE AND FASTENERS WHICH INCLUDE HEAVY GAUGE FLAT AND LOCK WASHERS.
 - ALL NEW PUMP STATIONS SHALL HAVE 480/277V, 3PH, 4-WIRE, 60HZ SERVICE, AS DESCRIBED IN THE COUNTY TECHNICAL SPECIFICATIONS, UNLESS OTHERWISE APPROVED BY THE COUNTY.
 - ELECTRICAL LAYOUT SUBJECT TO VARIATIONS BASED ON SPECIFIC SITE CONDITIONS, AS DETERMINED BY THE SITE-SPECIFIC DESIGN ENGINEER.
 - REFERENCE MECHANICAL DRAWINGS FOR SPECIFIC SITE DETAILS & DIMENSIONS, AND FOR COORDINATING THE INSTALLATION OF OTHER TRADES.
 - ROUTING SHOWN FOR CONDUITS AND GROUNDING CONDUCTORS ARE DIAGRAMMATIC. SITE-SPECIFIC DESIGN ENGINEER SHALL ROUTE CONDUITS AND GROUND CONDUCTORS AS FIELD CONDITIONS DICTATE UNLESS OTHERWISE NOTED.
 - GROUNDING BUSHINGS SHALL BE USED ON ALL METAL CONDUITS IN ALL ENCLOSURES.

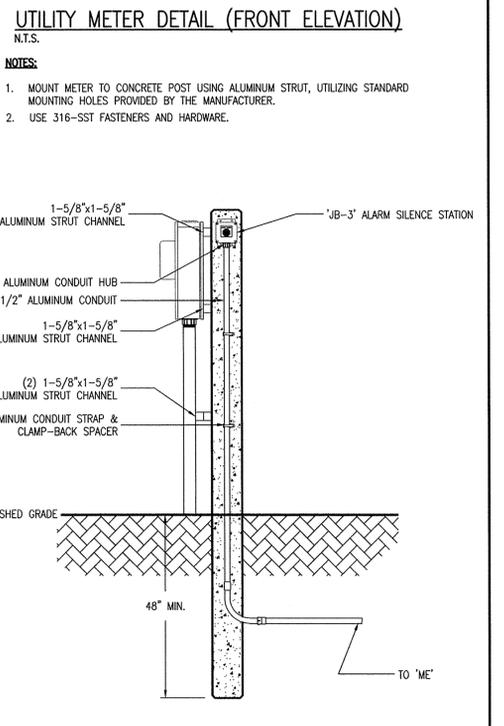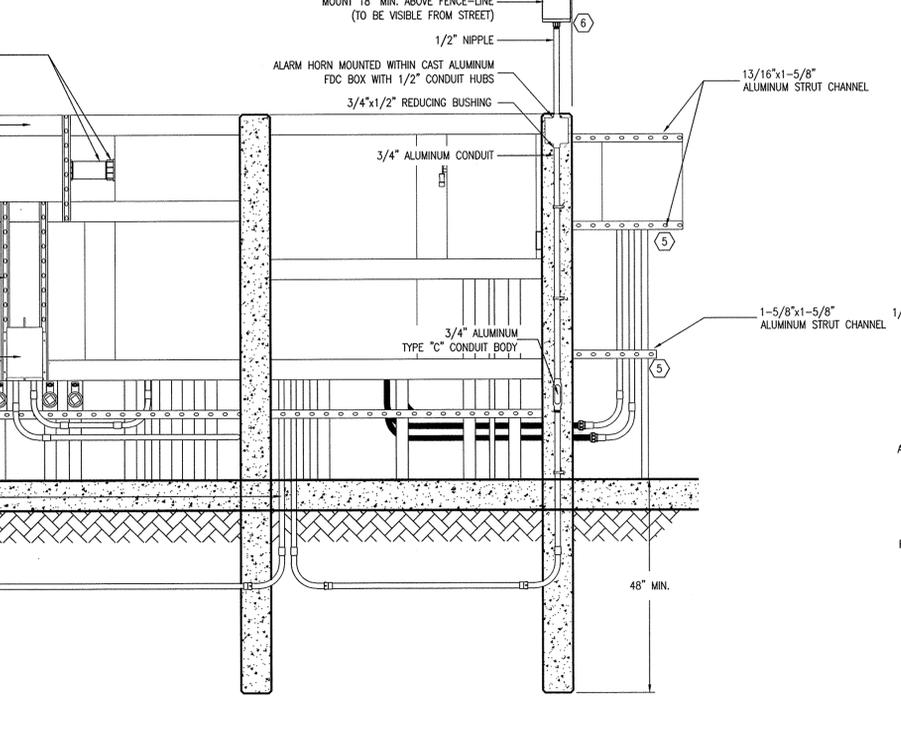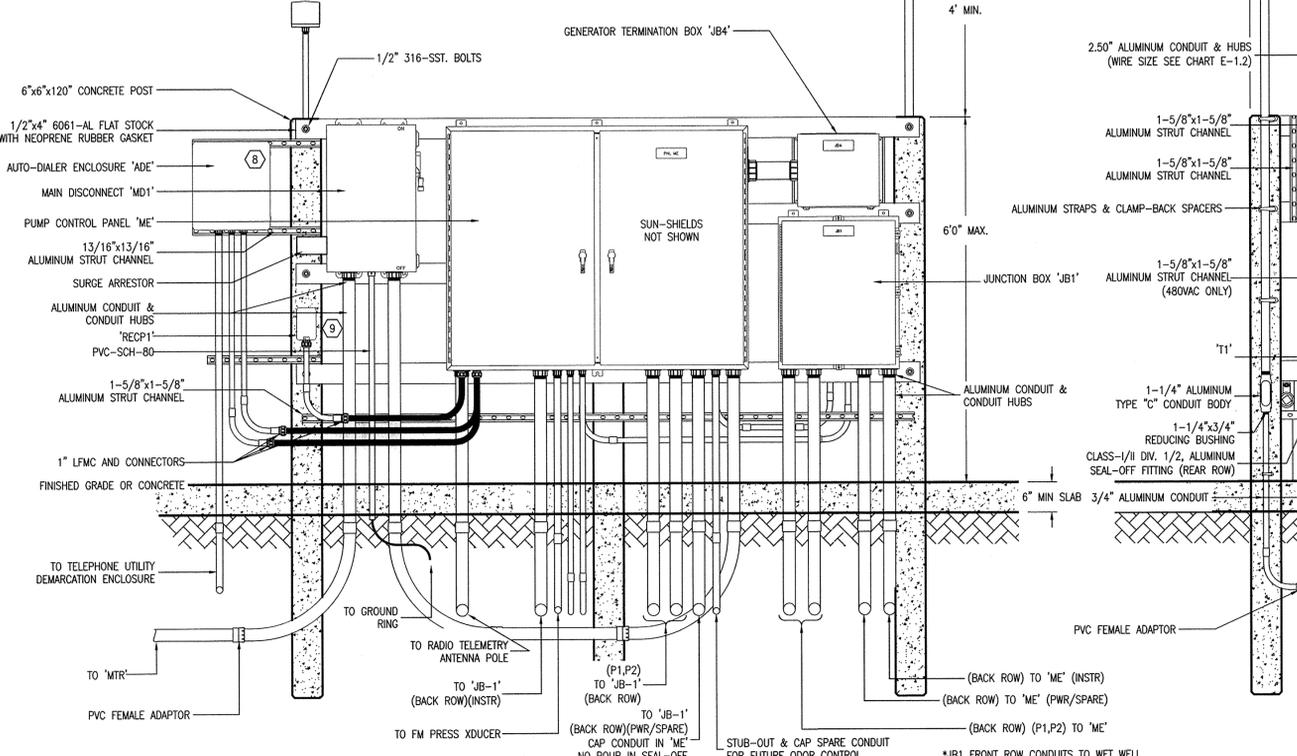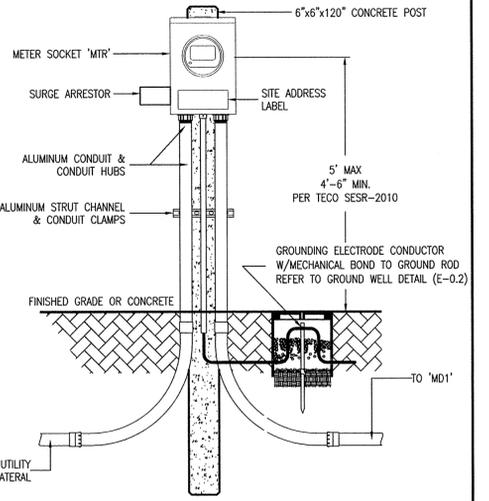

REVNO.	DESCRIPTIONS	DATE
2	REVISED TO INCORPORATE FIELD CHANGES	8/28/15
1	CONFORMED	5/17/13
REVISIONS		

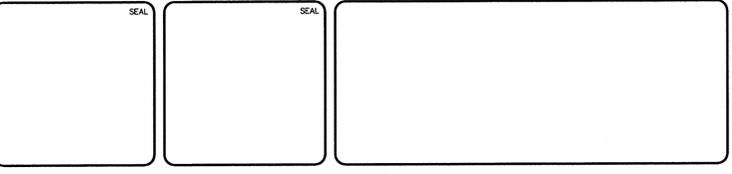


HILLSBOROUGH COUNTY
PUBLIC UTILITIES
ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH: (813) 272-5977

**DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION**

**ELECTRICAL POWER PLAN
AND DETAIL
(3PH) (480V/3-20HP)**


DATE: OCTOBER 2011	SCALE: HORIZONTAL	FILE NUMBER: E-0.1
PROJ. # 1179-0013	VERTICAL: NA	DRAWING NUMBER: 2
DRAWN: _____		
DESIGNED: _____		
CHECKED: _____		
PROJ. MGR: _____		
STATUS: REVISED		REVISION: 2

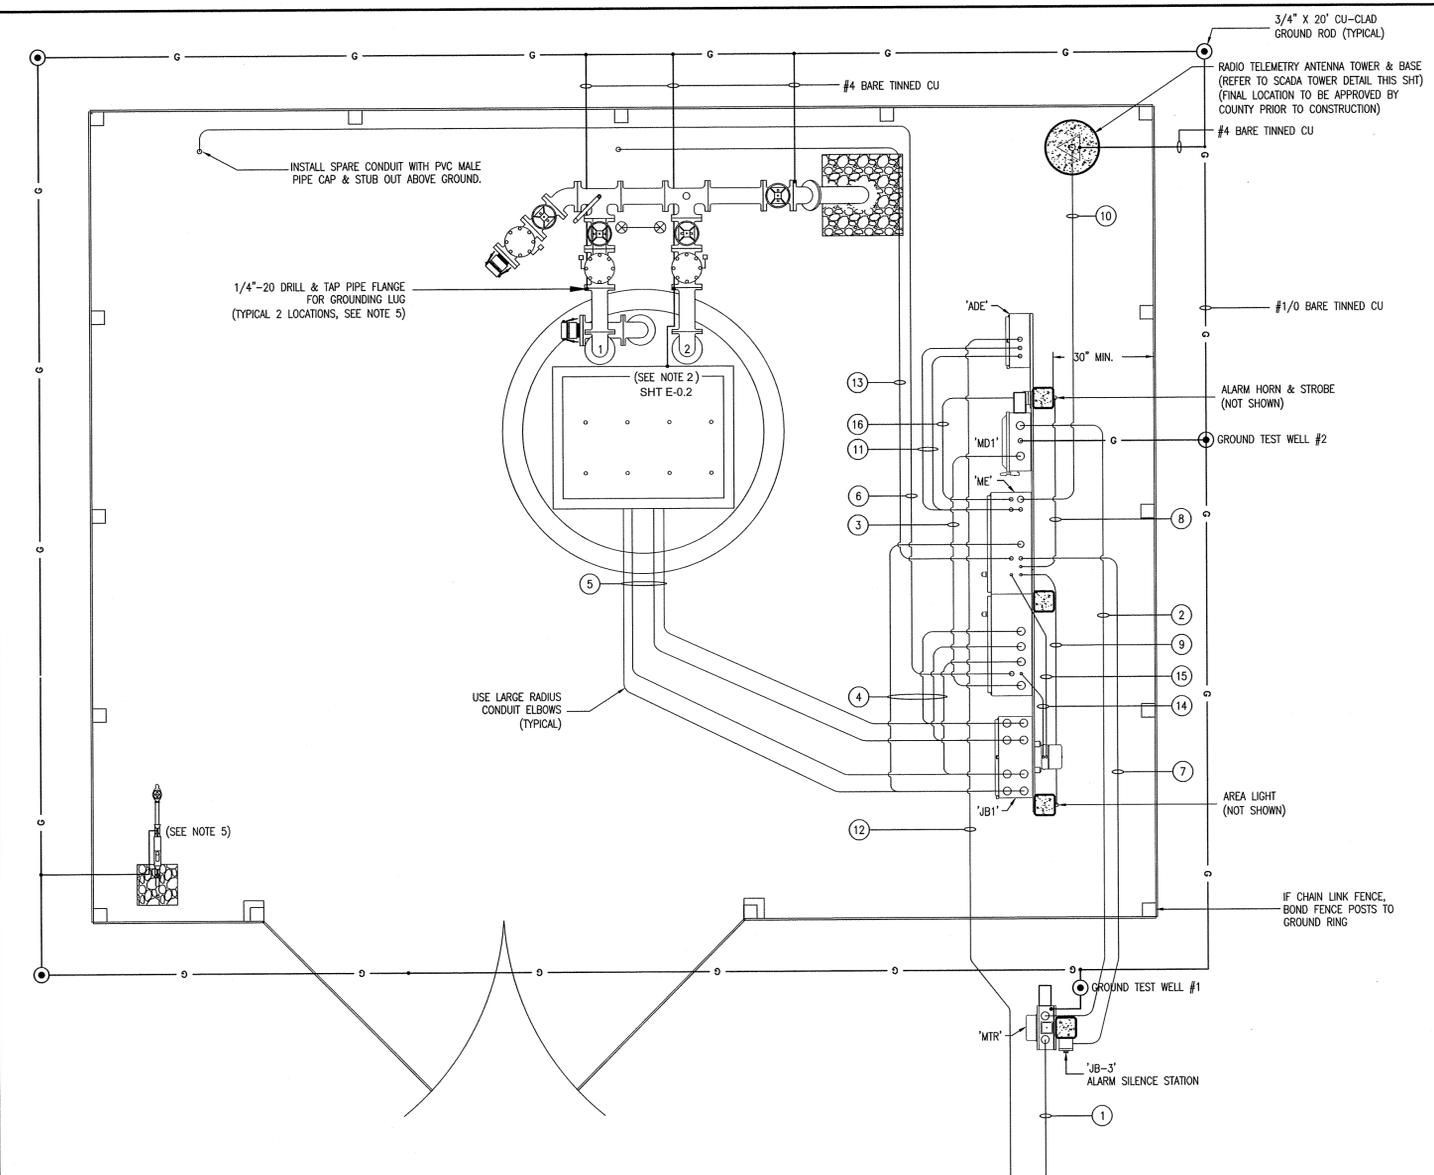


CONDUIT & CABLE NOTES:

- [SVC TO MTR] 2" C, WIRE SIZE SEE CHART E-1.2
- [MTR TO MD1] 2" C, WIRE SIZE SEE CHART E-1.2
- [MD1 TO ME/CB1] 2" C, WIRE SIZE SEE CHART E-1.2
- [ME/PMP1 TO JB1] 2" C, WIRE SIZE SEE CHART E-1.2
[ME/PMP2 TO JB1] 2" C, WIRE SIZE SEE CHART E-1.2
[ME/CONTL TO JB1] 2" C, FLOATS (24VAC) 6-#12 AWG,
WELL LEVEL (24VDC) 1-#16 STP
[ME/SPARE TO JB1] 2" C
- [JB1/PMP1 TO WELL] 2" C, MFR. CABLE
[JB1/PMP2 TO WELL] 2" C, MFR. CABLE
[JB1/CONTL TO WELL] 2" C, FLOATS (24VAC) MFR. CABLE,
WELL LEVEL (24VDC) MFR. CABLE
[JB1/SPARE TO WELL] 2" C
- [ME/SPARE TO ODOR CONT AREA] 1" C
- [ME/ALM SIL TO JB3] 0.5" C, (120VAC) 2-#14 #12G
- [ME/ALM STROBE-HORN TO JB2] 0.75" C, (120VAC) 4-#14 #12G
- [ME/AREA LIGHT TO AREA LIGHT] 0.75" C, (120VAC) 3-#12 #12G
- [ME/TELEM TO TELEMETRY ANTENNA POLE] 2" C, ANTENNA CABLE
- [ME/ADE TO ADE] 0.75" C, ADE POWER (120VAC) 2-#12 #12G
0.75" C, ADE CONTROL (24VDC) 10-#14 #12G
- [ADE TO TELECOM SVC] 1" C, TELEPHONE CABLE
- [ME/PRESS TO FM PRESS TRANSMITTER] 1" C, 1-16STP
- (480VAC ONLY)
[ME/CB11 TO T1] 0.75" C, (480VAC) 2-#12 #12G
- (480VAC ONLY)
[T1 TO ME/CB12] 0.75" C, (120VAC) 2-#10
- [ME/CB21 TO RECP1] 0.75" C, RECP1 POWER (120VAC) 2-#12 #12G

ELECTRICAL SITE PLAN
1/2" = 1'

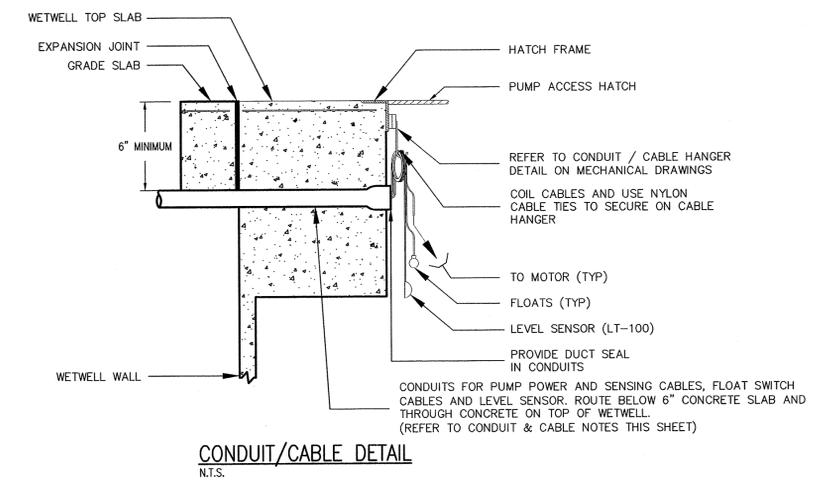


CONDUIT/CABLE DETAIL
N.T.S.

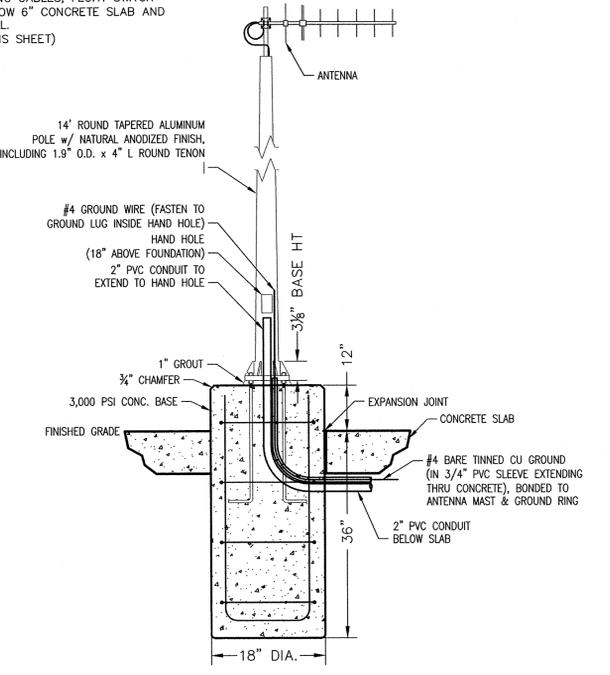

DETAIL NOTES:

- PROVIDE ANCHORS, HARDWARE, CONCRETE SUPPORTS, ETC., AS NEEDED TO SECURE ANTENNA TOWER.
- REFER TO MECHANICAL DRAWINGS AND SPECIFICATIONS FOR ANTENNA AND FOUNDATION DETAILS.

SCADA ANTENNA TOWER DETAIL
N.T.S.

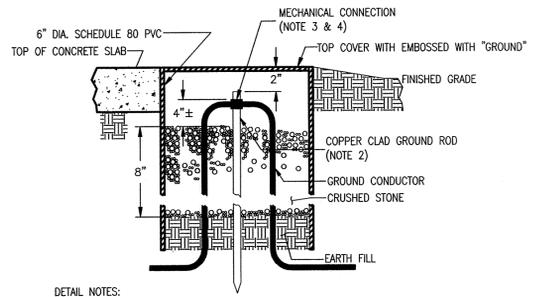

DETAIL NOTES:

- TYPICAL FOR EACH GROUND ROD.
- 3/4" x 20" COPPER CLAD DRIVEN GROUND ROD; THREE (3) GROUND RODS MINIMUM PER SITE.
- "TEST WELLS" AT TCCO METER & MD1 SHALL USE MECHANICAL CONNECTIONS, TO FACILITATE ISOLATING THE GROUNDING SYSTEM FROM THE UTILITY GROUND FOR TESTING PURPOSES.
- CONTRACTOR SHALL MEASURE THE RESISTANCE OF INSTALLED GROUNDING ELECTRODES AND IF ABOVE 5 OHMS, CONTRACTOR SHALL AUGMENT THE GROUND SYSTEM AS NECESSARY.

GROUND TEST WELL DETAIL
N.T.S.

DESIGN BASIS NOTE:
THIS DRAWING REPRESENTS THE STANDARD DESIGN FOR ALL HILLSBOROUGH COUNTY STANDARD WASTEWATER PUMPING STATIONS. IT WAS DEVELOPED TO IMPROVE RELIABILITY AND MAINTAINABILITY, MINIMIZE SPARE PARTS AND INCREASE SERVICE LIFE. ALL REQUESTS FOR DEVIATION FROM THIS STANDARD MUST BE MADE IN WRITING AND WRITTEN APPROVAL RECEIVED BEFORE MODIFICATIONS ARE MADE. CONTRACTOR IS RESPONSIBLE FOR ALL COSTS NECESSARY TO RESTORE UNAUTHORIZED MODIFICATIONS.

DESIGN ENGINEER NOTE: *THIS IS NOT A CONSTRUCTION DRAWING*
DESIGN ENGINEER SHALL REFER TO ELECTRICAL DRAWINGS, MECHANICAL DRAWINGS, AND THE HILLSBOROUGH COUNTY WATER AND WASTEWATER TECHNICAL SPECIFICATION IN ORDER TO COORDINATE THE MECHANICAL AND ELECTRICAL INSTALLATIONS. DESIGN ENGINEER SHALL NOT USE THIS DRAWING FOR A SPECIFIC SITE INSTALLATION. FOR EACH INSTALLATION A SPECIFIC SET OF CONSTRUCTION DRAWINGS AND SPECIFICATIONS (IF DEEMED NECESSARY BY THE DESIGN ENGINEER) MUST BE PREPARED IN ACCORDANCE WITH F.S. 471 AND RULES 61G.

REV. NO.	DESCRIPTION	DATE
2	REVISED TO INCORPORATE FIELD CHANGES	8/28/15
1	CONFORMED	5/7/13
1	CONFORMED	5/7/13

SEAL

SEAL

HILLSBOROUGH COUNTY
PUBLIC UTILITIES
ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5877


**DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION**

**ELECTRICAL SITE PLAN
AND DETAIL
(3PH) (480V/3-20HP)**

DATE: OCTOBER 2011	SCALE:	FILE NUMBER:
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER:
DESIGNED:	VERTICAL:	E-0.2
CHECKED:	NA	
PROJ. MGR.:		
STATUS: REVISED		REVISION 2

NOTES:




1. REFER TO SHT. E-1.2 FOR BILL OF MATERIAL, NAMEPLATE LEGEND AND ELECTRICAL SIZING; E-1.3 THRU E-1.8 FOR SCHEMATICS.
2. WELDED CABINET DIVIDER SHALL PROVIDE COMPLETE ISOLATION BETWEEN CABINET HALVES.
3. ATTACH SUN-SHIELD WITH STAINLESS STEEL HARDWARE. TYPICAL.
4. REMOVABLE LIFTING EYE SOCKET. IMMEDIATELY AFTER CABINET INSTALLATION, INSTALL SS PLUG BOLT AND RUBBER WASHER TO PROVIDE WATER-TIGHT SEAL. TYPICAL (2).
5. INSTALL PASS-THROUGH CABLE FITTINGS AT DIVIDER PLATE (BOTTOM & CENTERED) TYP. 3 (POWER, COMM, CONTROL)

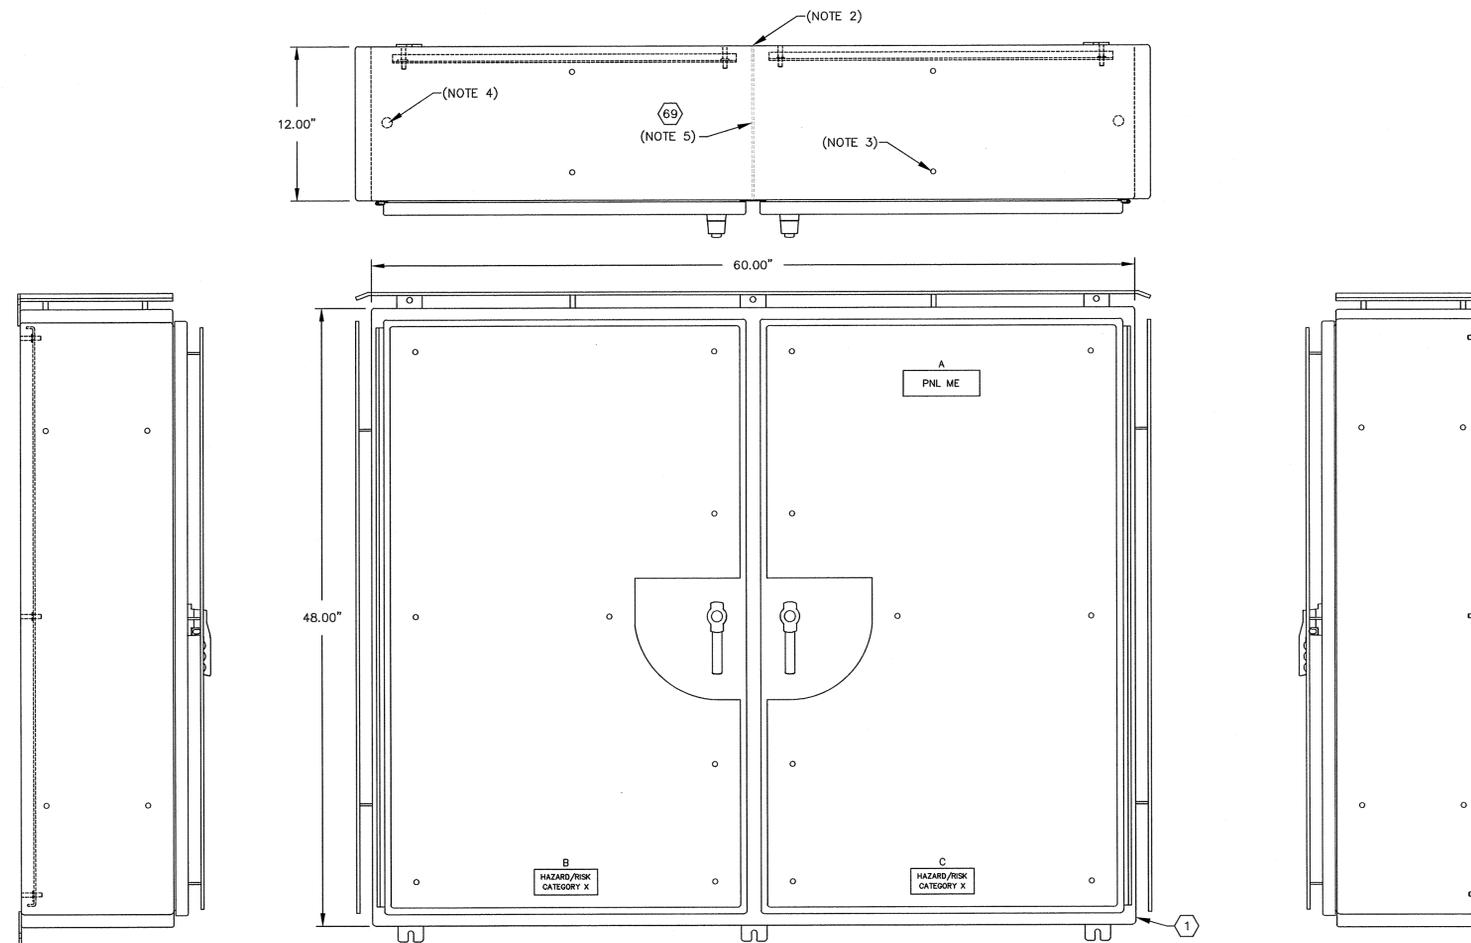

EXTERIOR ELECTRICAL/CONTROL CABINET, (ME)

5/32"=1"

REV. NO.	DESCRIPTIONS	DATE
2	REVISED, TO INCORPORATE FIELD CHANGES	8/26/15
1	CONFORMED	5/17/13
REVISIONS		

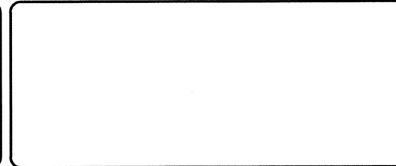



HILLSBOROUGH COUNTY
 PUBLIC UTILITIES
 ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5977


DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

ELECTRICAL/CONTROL ENCLOSURE
EXTERIOR LAYOUT
(3PH)(480V/3-20HP)

DATE: OCTOBER 2011	SCALE	FILE NUMBER
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER
DRAWN	VERTICAL:	E-1.0
DESIGNED	NA	REVISION
CHECKED		2
PROJ. MGR.		
STATUS: REVISED		

NOTES:




1. REFER TO SHT. E-1.2 FOR BILL OF MATERIAL, NAMEPLATE LEGEND AND ELECTRICAL SIZING; E-1.3 THRU E-1.8 FOR SCHEMATICS.
2. INSTALL STAND-OFF BRACKETS AS REQ'D TO EXTEND CIRCUIT BREAKERS TO INNER DOOR.

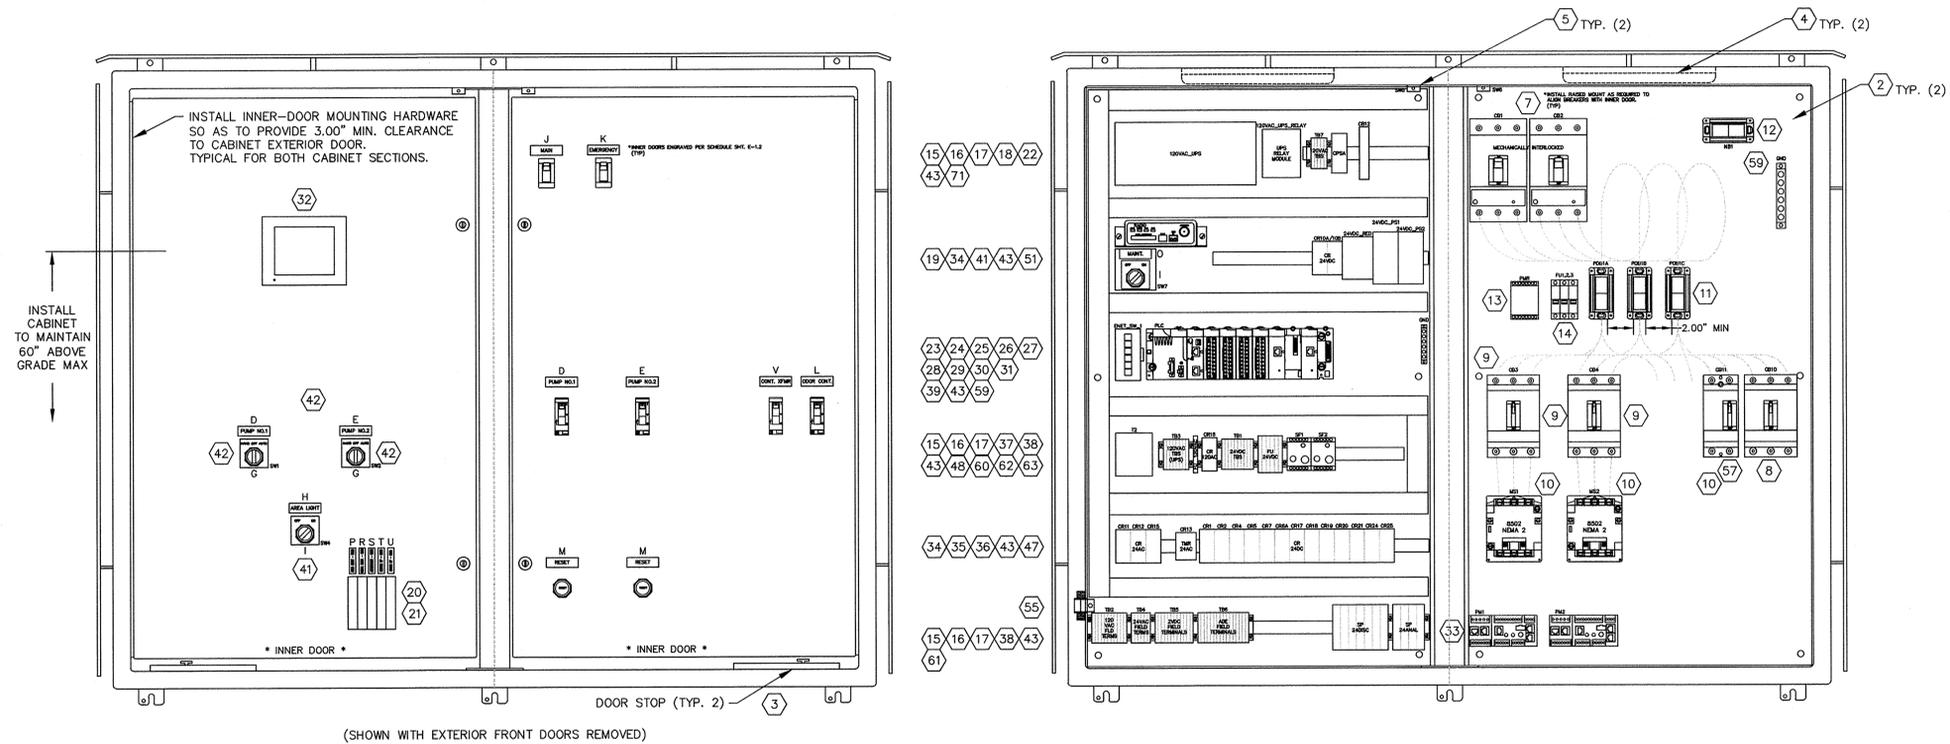

INTERIOR ELECTRICAL/CONTROL CABINET, (ME)

5/32"=1"

REV. NO.	DESCRIPTIONS	DATE
2	REVISED, TO INCORPORATE FIELD CHANGES	6/26/15
1	CONFIRMED	5/17/13

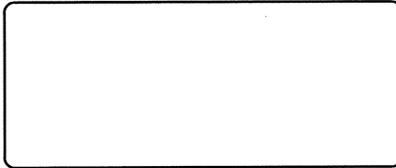

HILLSBOROUGH COUNTY
PUBLIC UTILITIES
ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5977

DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

ELECTRICAL/CONTROL ENCLOSURE
INTERIOR LAYOUT
(3PH)(480V/3-20HP)

DATE:	OCTOBER 2011
PROJ. #	1179-0013
DRAWN	
DESIGNED	
CHECKED	
PROJ. MGR.	

SCALE	
HORIZONTAL:	
VERTICAL:	NA

FILE NUMBER	
DRAWING NUMBER	E-1.1
REVISION	2

STATUS: REVISED

LIST OF MAJOR COMPONENTS

ELECTRICAL/CONTROL CABINET (ME)				
ITEM NO.	QTY	DEVICE ID	MANUFACTURER	DESCRIPTION
1	1		HOFFMAN	A48H012W FSSLP-3PT (CUSTOM)
2	2		HOFFMAN	ICUS TOM
3	2		FABTECH	NI-46013
4	2		GE	UCF1810WADY-10647
5	2	SW5, SW6	GE	FL1810WADY-10147
6	1	JB4		9007-AP221
7	2	CB1, CB2	SEE CHART THIS SHT.	GENERATOR TERMINATION PANEL, REFER TO SHT. E-50
8	1	CB10	SQUARE-D	JUL30250U31X
9	2	CB3, CB4	SEE CHART THIS SHT.	CIRCUIT BREAKER, 600V, 3 POLE, 250 AMP, ELECTRONIC TRIP (MICROLOGIC), MECH-INTERLOCK
10	2	MB1, MB2	SEE CHART THIS SHT.	CIRCUIT BREAKER, MOLDED-CASE, 600V, 3 POLE, 15 AMP TRIP UNIT
11	3	PDB1A,B,C	BUSSMANN	HGL30020T
12	1	NB1	BUSSMANN	HGL30020T
13	1	PMR	MACROMATIC	HGL30020T
14	1	FU1, FU2, FU3	SQUARE-D	HGL30040T
15	78		ENTRELEC	8502-SC02-V02S
16	10		ENTRELEC	8502-SD02-V02S
17	19		WAGO	18325-1
18	4	120VAC UPS	SOLA	18325-1
19	2	120VAC UPS RELAY	SOLA	PMU
20	2	24VDC PS1, 24VDC PS2	WEIDMULLER	8501NRB1
21	1	24VDC RED	WEIDMULLER	DFCC3V
22	1	CB20, CB22, CB23, CB24	SQUARE-D	1P-CC-1
23	1	CB21	SQUARE-D	115 118 07
24	1	CB24	SQUARE-D	118 308 16
25	1	FLC BP	MODICON	248-117
26	1	FLC MOD 0	MODICON	SDU-850
27	1	FLC MOD 1	MODICON	RELAYCARD-SDU
28	2	FLC MOD 2	MODICON	8561360000
29	1	FLC MOD 3	MODICON	8710620000
30	4	FLC MOD 4	MODICON	COU1103100
31	1	FLC MOD 5	MODICON	COU1153100
32	1	FLC MOD 7	MODICON	CITEL
33	2	PM1, PM2	SQUARE-D	DS42S-120
34	15	CR1, 2, 4, 6, 7, 8, 10A, 10B, 17, 18, 19, 20, 21, 24, 25	SQUARE-D	BMXCBP0300
35	4	CR11, 12, 15	SQUARE-D	BMXCP3300
36	20	SF1, SF2	SQUARE-D	BMXPP2200
37	2		SQUARE-D	BMXDD1602
38	4		SQUARE-D	BMXDR1605
39	2		SQUARE-D	BMXAM0810
40	1		SQUARE-D	BMXAM0210
41	1		SQUARE-D	BMXMTB2000
42	1		SQUARE-D	BMXNOE1000
43	1		SQUARE-D	BMXNOR200H
44	1		SQUARE-D	MAGELIS XBTGT2830
45	1		SQUARE-D	LTMR27ERD
46	1		SQUARE-D	LTMEV4BRD
47	1		SQUARE-D	LTMC0004
48	1		SQUARE-D	9001SKR1B15
49	1		SQUARE-D	RXM44B1B0
50	1		SQUARE-D	RXM44B1B7
51	1		SQUARE-D	RXZE2M114
52	1		SQUARE-D	PNRU110A/BE
53	1		SQUARE-D	8501NRB1
54	1		SQUARE-D	MIN-CAS
55	1		SQUARE-D	DLA-24D3
56	1		SQUARE-D	TS5S8082F23F0
57	1		SQUARE-D	GFTR18VY
58	1		SQUARE-D	THOMAS & BETTS
59	1		SQUARE-D	WP1010MND
60	1		SQUARE-D	9001 KS11B2
61	1		SQUARE-D	9001 KS43B2
62	1		SQUARE-D	IB-T1-1030W
63	1		SQUARE-D	IB-T1-1530W
64	1		SQUARE-D	141ST-24R
65	1		SQUARE-D	480E-24-31 w/WB
66	1		SQUARE-D	*NOT USED
67	1		SQUARE-D	9001JCK11V14
68	1		SQUARE-D	8501NRB1
69	1		SQUARE-D	9070T100D23
70	1		SQUARE-D	PNR21-PE-2-2-1H-G-K41-A-PO-PS
71	1		SQUARE-D	3051TG3A2B21AT1M5
72	1		SQUARE-D	220-MDS-SD2P-B-ES-ETHERNET
73	1		SQUARE-D	STEP-PS-100-240AC/120C/3
74	1		SQUARE-D	ASTRON
75	1		SQUARE-D	220-4H
76	1		SQUARE-D	LML-400
77	1		SQUARE-D	IS-50NXC2
78	1		SQUARE-D	F2A-PNMINR-0
79	1		SQUARE-D	HGL26015
80	1		SQUARE-D	3S1FSS
81	1		SQUARE-D	PK0GTAB
82	1		SQUARE-D	RXM44B2F7
83	1		SQUARE-D	DLA-24D3
84	1		SQUARE-D	GNA-2R
85	1		SQUARE-D	GNA-500-R
86	1		SQUARE-D	173 523 11
87	1		SQUARE-D	168 973 07
88	1		SQUARE-D	115 857 25
89	1		SQUARE-D	118 951 15
90	1		SQUARE-D	*NOT USED
91	1		SQUARE-D	ZS105
92	1		SQUARE-D	ZS108
93	1		SQUARE-D	ZS210
94	1		SQUARE-D	*NOT USED
95	1		SQUARE-D	COU1130

NAMEPLATE SCHEDULE

ELECTRICAL/CONTROL CABINET (ME)		
N.P. NO.	QTY	PLATE COLOR/SIZE
A	1	BLK/2.00" H x 6.00" W
B	1	BLK/2.00" H x 6.00" W
C	1	BLK/2.00" H x 6.00" W
D	2	ENG/0.75" H x 2.50" W
E	2	ENG/0.75" H x 2.50" W
F		*NOT USED
G	2	ENG/2.25" H x 2.25" W
H	1	ENG/0.75" H x 2.50" W
I	2	ENG/2.25" H x 2.25" W
J	1	ENG/0.75" H x 2.50" W
K	1	ENG/0.75" H x 2.50" W
L	1	ENG/0.75" H x 2.50" W
M	2	ENG/0.75" H x 2.50" W
N		*NOT USED
O	1	ENG/0.75" H x 2.50" W
P	1	ENG/0.50" H x 2.00" W
R	1	ENG/0.50" H x 2.00" W
S	1	ENG/0.50" H x 2.00" W
T	1	ENG/0.50" H x 2.00" W
U	1	ENG/0.50" H x 2.00" W
V	1	ENG/0.75" H x 2.50" W
W		*NOT USED

CROSS REFERENCE TABLE

SERVICE VOLTAGE	PUMP HP	PUMP FLA (PER NEC)	MTR (AWG)	MD1-ME/CB1 J1/JB4-CB2/N (AWG)	CB1-PDB1 (AWG)	MD1 CB1 SETTINGS J (tr/tr/rl)	GENERATOR CONNECTION	PDB1-PMR (AWG)	CB3 CB4	MS1 MS2	PDB1-CB3 PDB1-CB4 CB3-MS1 CB4-MS2 MS1-JB1 MS2-JB1 (AWG)	JB1-M1 JB1-M2	ODOR CONTROL CB10	PDB1-CB10 (AWG)	PDB1-CB20 (AWG)	PDB1-CB11 CB11-XFMR1 (AWG)	CB11
480VAC, 3PH, 4W	3	4.8	3-#3, 1-#3 N	3-#3, 1-#3 N, 1-#6 G	3-#3	J250(100/2/4)	JB4	3-#14	H15	SIZE 0	3-#12	PER MANUF	H20	3-#12	---	2-#10	H15
480VAC, 3PH, 4W	5	7.6	3-#3, 1-#3 N	3-#3, 1-#3 N, 1-#6 G	3-#3	J250(100/2/4)	JB4	3-#14	H15	SIZE 0	3-#12	PER MANUF	H20	3-#12	---	2-#10	H15
480VAC, 3PH, 4W	7.5	11.0	3-#3, 1-#3 N	3-#3, 1-#3 N, 1-#6 G	3-#3	J250(100/2/5)	JB4	3-#14	H20	SIZE 1	3-#12	PER MANUF	H20	3-#12	---	2-#10	H15
480VAC, 3PH, 4W	10	14.0	3-#3, 1-#3 N	3-#3, 1-#3 N, 1-#6 G	3-#3	J250(100/2/5)	JB4	3-#14	H25	SIZE 1	3-#12	PER MANUF	H20	3-#12	---	2-#10	H15
480VAC, 3PH, 4W	15	21.0	3-#3, 1-#3 N	3-#3, 1-#3 N, 1-#6 G	3-#3	J250(100/4/5)	JB4	3-#14	H40	SIZE 2	3-#8	PER MANUF	H20	3-#12	---	2-#10	H15
480VAC, 3PH, 4W	20	27.0	3-#3, 1-#3 N	3-#3, 1-#3 N, 1-#6 G	3-#3	J250(100/8/5)	JB4	3-#14	H50	SIZE 2	3-#8	PER MANUF	H20	3-#12	---	2-#10	H15

EQUIPMENT AND CONDUCTORS SHALL COMPLY WITH NEC AND ALL OTHER APPLICABLE CODES, INCLUDING EXISTING COUNTY STANDARDS.

DESIGN BASIS NOTE:

THIS DRAWING REPRESENTS THE STANDARD DESIGN FOR ALL HILLSBOROUGH COUNTY STANDARD WASTEWATER PUMPING STATIONS. IT WAS DEVELOPED TO IMPROVE RELIABILITY AND MAINTAINABILITY, MINIMIZE SPARE PARTS AND INCREASE SERVICE LIFE. ALL REQUESTS FOR DEVIATION FROM THIS STANDARD MUST BE MADE IN WRITING AND WRITTEN APPROVAL RECEIVED BEFORE MODIFICATIONS ARE MADE. CONTRACTOR IS RESPONSIBLE FOR ALL COSTS NECESSARY TO RESTORE UNAUTHORIZED MODIFICATIONS.

DESIGN ENGINEER NOTE:

THIS IS NOT A CONSTRUCTION DRAWING

DESIGN ENGINEER SHALL REFER TO ELECTRICAL DRAWINGS, MECHANICAL DRAWINGS, AND THE HILLSBOROUGH COUNTY WATER AND WASTEWATER TECHNICAL SPECIFICATION IN ORDER TO COORDINATE THE MECHANICAL AND ELECTRICAL INSTALLATIONS. DESIGN ENGINEER SHALL NOT USE THIS DRAWING FOR A SPECIFIC SITE INSTALLATION. FOR EACH INSTALLATION A SPECIFIC SET OF CONSTRUCTION DRAWINGS AND SPECIFICATIONS (IF DEEMED NECESSARY BY THE DESIGN ENGINEER) MUST BE PREPARED IN ACCORDANCE WITH F.S. 471 AND RULES 61C.

REV. NO.	DESCRIPTION	DATE
2	REVISED TO INCORPORATE FIELD CHANGES	8/28/15
1	CONFIRMED	5/17/13

SEAL

SEAL

SEAL

SEAL




HILLSBOROUGH COUNTY
 PUBLIC UTILITIES
 ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5977

DUPLIX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

ELECTRICAL/CONTROL ENCLOSURE
BILL OF MATERIAL & EQUIP SIZING CHART
(3PH)(480V/3-20HP)

DATE: OCTOBER 2011	SCALE: HORIZONTAL	FILE NUMBER: 1179-0013
PROJ. #	VERTICAL: NA	DRAWING NUMBER: E-1.2
DRAWN		
DESIGNED		
CHECKED		
PROJ. MGR.		
STATUS: REVISED		REVISION: 2

ELECTRICAL/CONTROL CABINET, (ME)

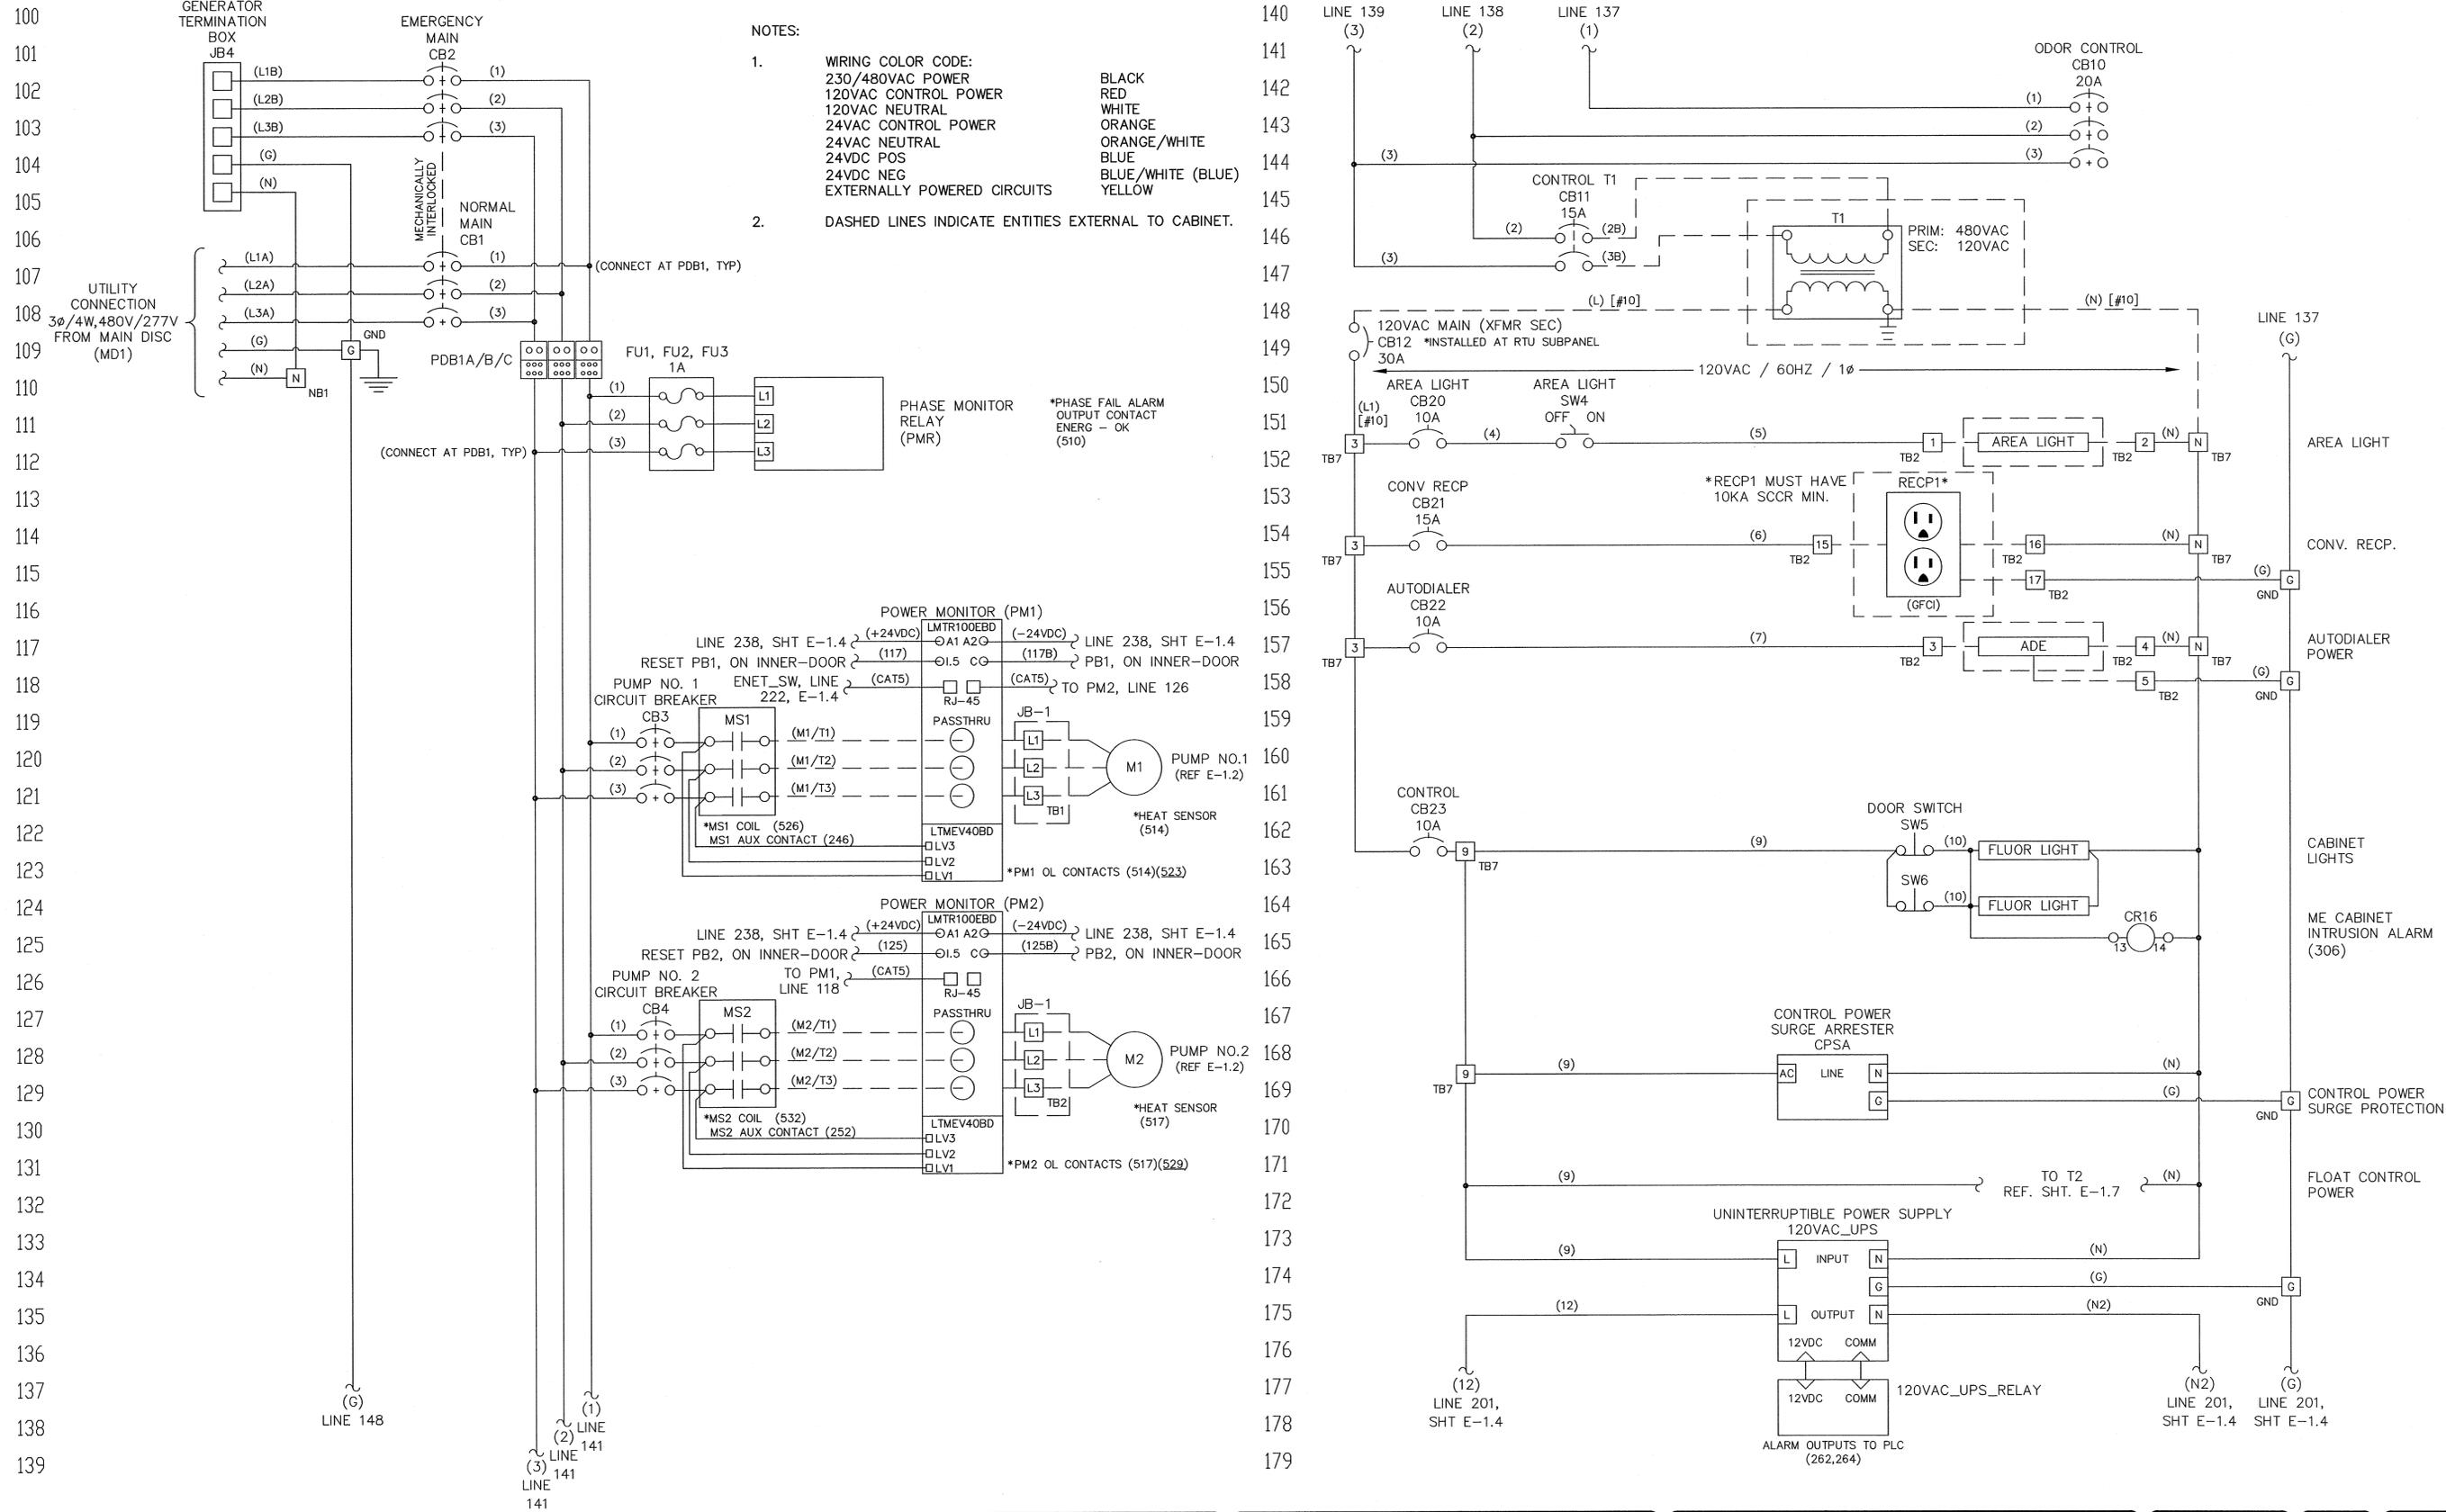



- NOTES:
- WIRING COLOR CODE:

230/480VAC POWER	BLACK
120VAC CONTROL POWER	RED
120VAC NEUTRAL	WHITE
24VAC CONTROL POWER	ORANGE
24VAC NEUTRAL	ORANGE/WHITE
24VDC POS	BLUE
24VDC NEG	BLUE/WHITE (BLUE)
EXTERNALLY POWERED CIRCUITS	YELLOW
 - DASHED LINES INDICATE ENTITIES EXTERNAL TO CABINET.

100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120
121
122
123
124
125
126
127
128
129
130
131
132
133
134
135
136
137
138
139

140
141
142
143
144
145
146
147
148
149
150
151
152
153
154
155
156
157
158
159
160
161
162
163
164
165
166
167
168
169
170
171
172
173
174
175
176
177
178
179

REV. NO.	DESCRIPTIONS	DATE
2	REVISED TO INCORPORATE FIELD CHANGES	8/26/15
1	CONFORMED	5/11/13

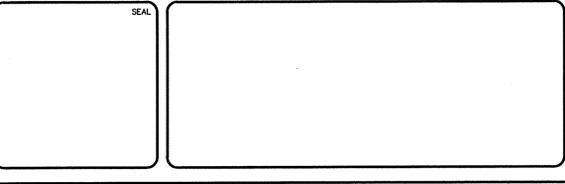



HILLSBOROUGH COUNTY
PUBLIC UTILITIES
ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5977

DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

**ELECTRICAL/CONTROL ENCLOSURE
ELECTRICAL SCHEMATICS
(3PH)(480V/3-20HP)**


DATE: OCTOBER 2011	SCALE	FILE NUMBER
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER
DESIGNED	VERTICAL:	E-1.3
CHECKED	NA	REVISION
PROJ. MGR.		2

ELECTRICAL/CONTROL CABINET, (ME), CONTINUED


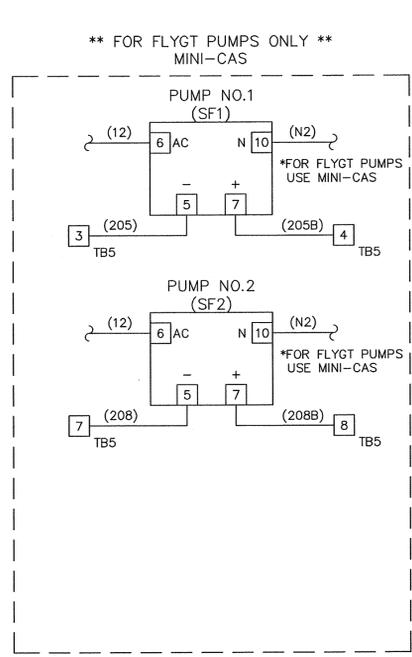
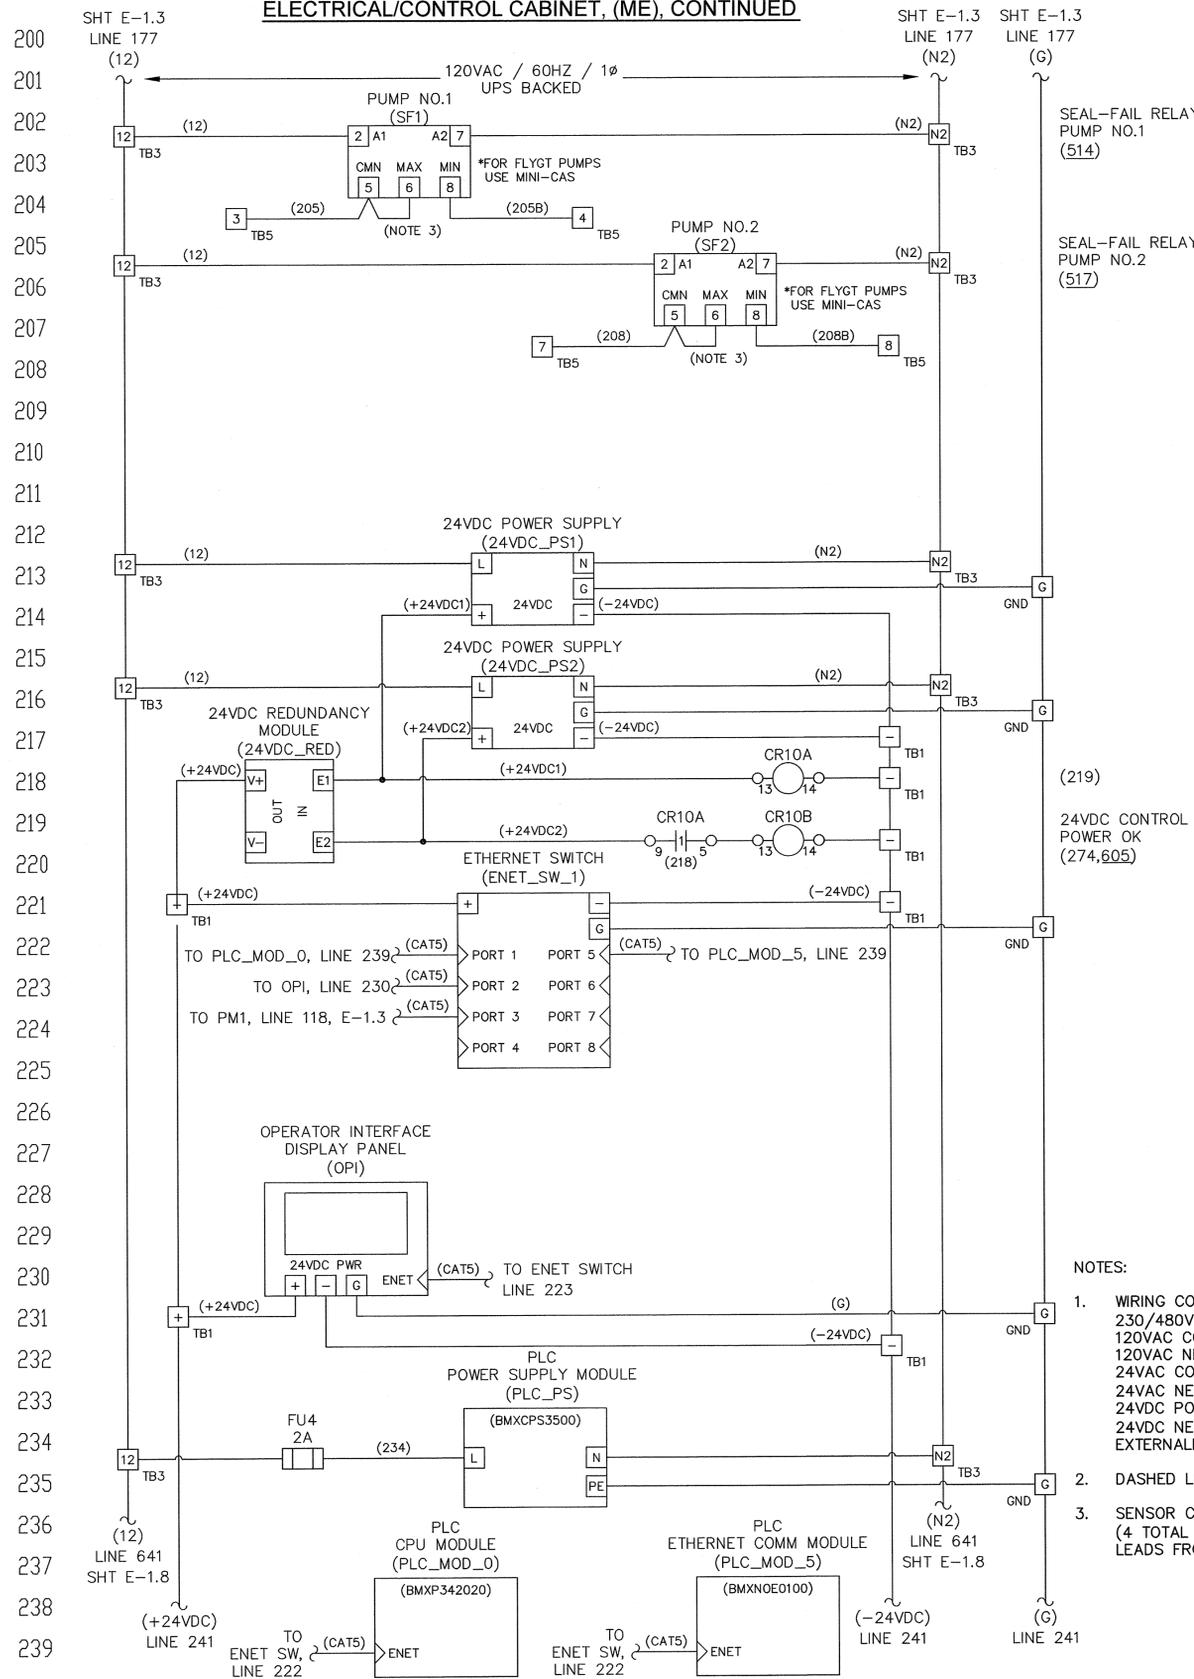


- NOTES:**
1. WIRING COLOR CODE:
 230/480VAC POWER: BLACK
 120VAC CONTROL POWER: RED
 120VAC NEUTRAL: WHITE
 24VAC CONTROL POWER: ORANGE
 24VAC NEUTRAL: ORANGE/WHITE
 24VDC POS: BLUE
 24VDC NEG: BLUE/WHITE (BLUE)
 EXTERNALLY POWERED CIRCUITS: YELLOW
 2. DASHED LINES INDICATE ENTITIES EXTERNAL TO CABINET.
 3. SENSOR CABLE SHALL CONTAIN HEAT SENSING AND SEAL FAILURE LEADS (4 TOTAL PER PUMP) AND SHALL BE INSTALLED IN CONDUIT WITH MOTOR LEADS FROM JUNCTION BOX JB1 TO THE WET WELL.

ELECTRICAL/CONTROL CABINET, (ME), CONTINUED

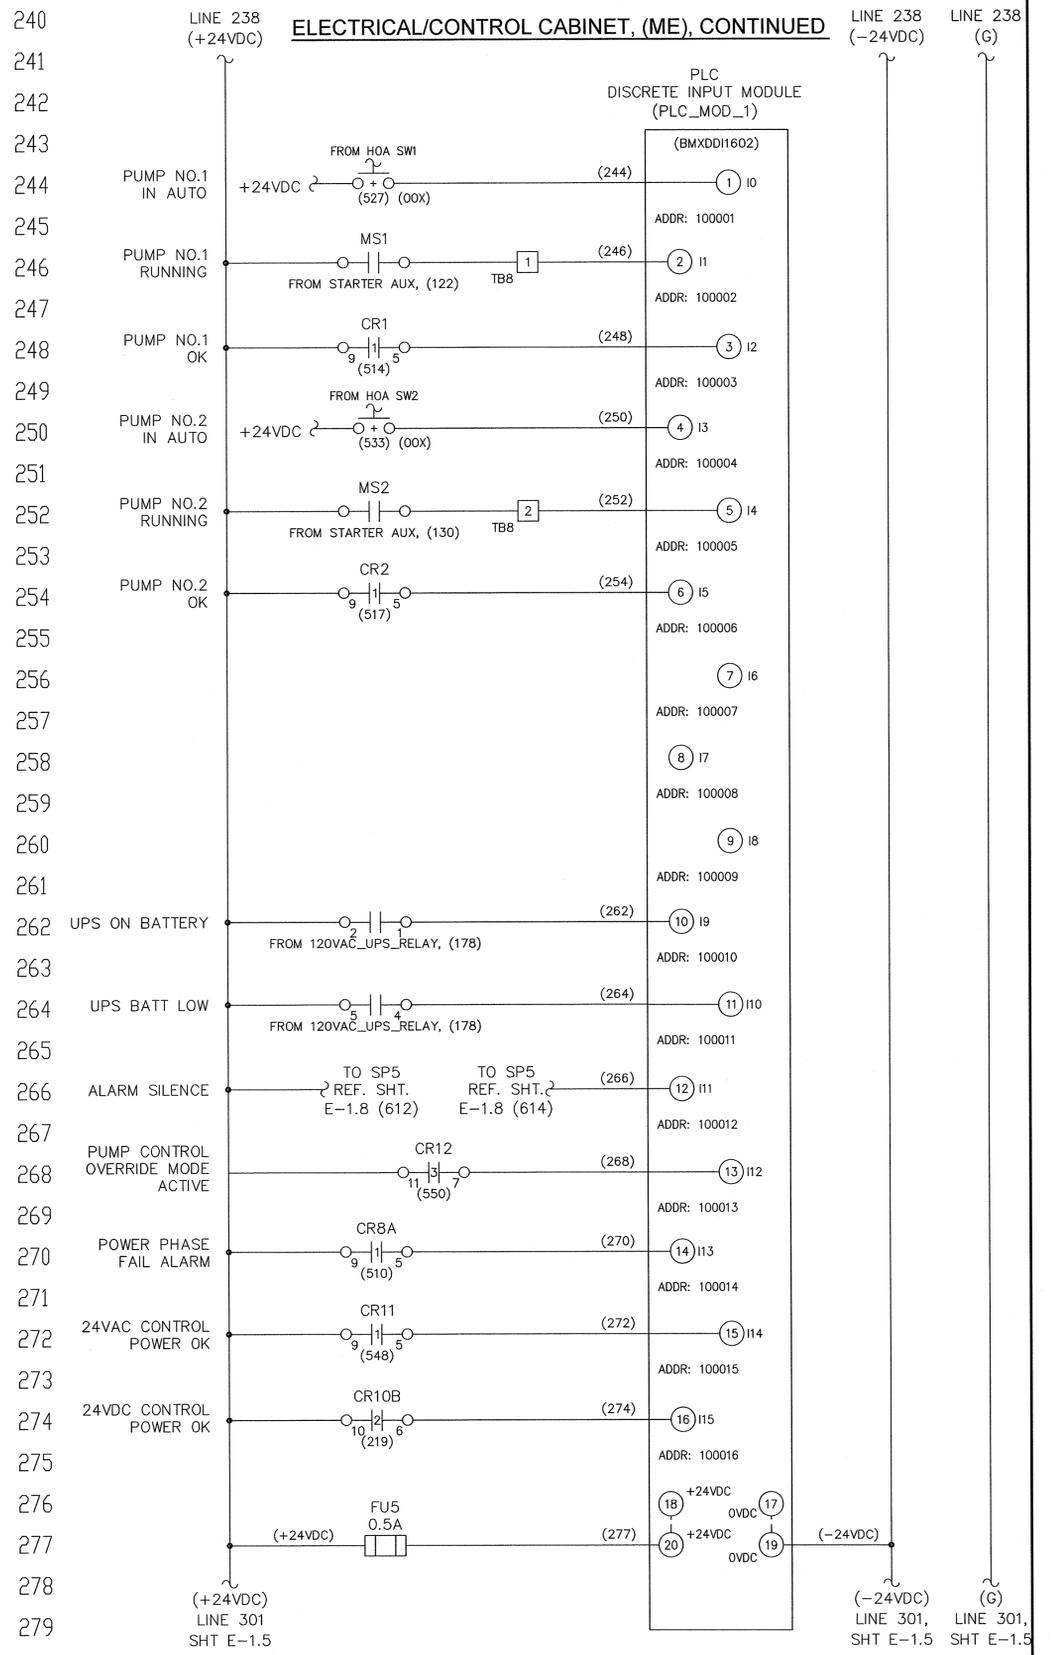

REV.	DESCRIPTION	DATE
2	REVISED, TO INCORPORATE FIELD CHANGES	8/26/15
1	CONFORMED	5/17/13




HILLSBOROUGH COUNTY
PUBLIC UTILITIES
ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWIGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5977

DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

ELECTRICAL/CONTROL ENCLOSURE
ELECTRICAL SCHEMATICS
(3PH)(480V/3-20HP)


DATE: OCTOBER 2011	SCALE:	FILE NUMBER:
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER:
DRAWN:	VERTICAL:	E-1.4
DESIGNED:	NA	
CHECKED:		
PROJ. MGR.:		
STATUS: REVISED	REVISION:	2

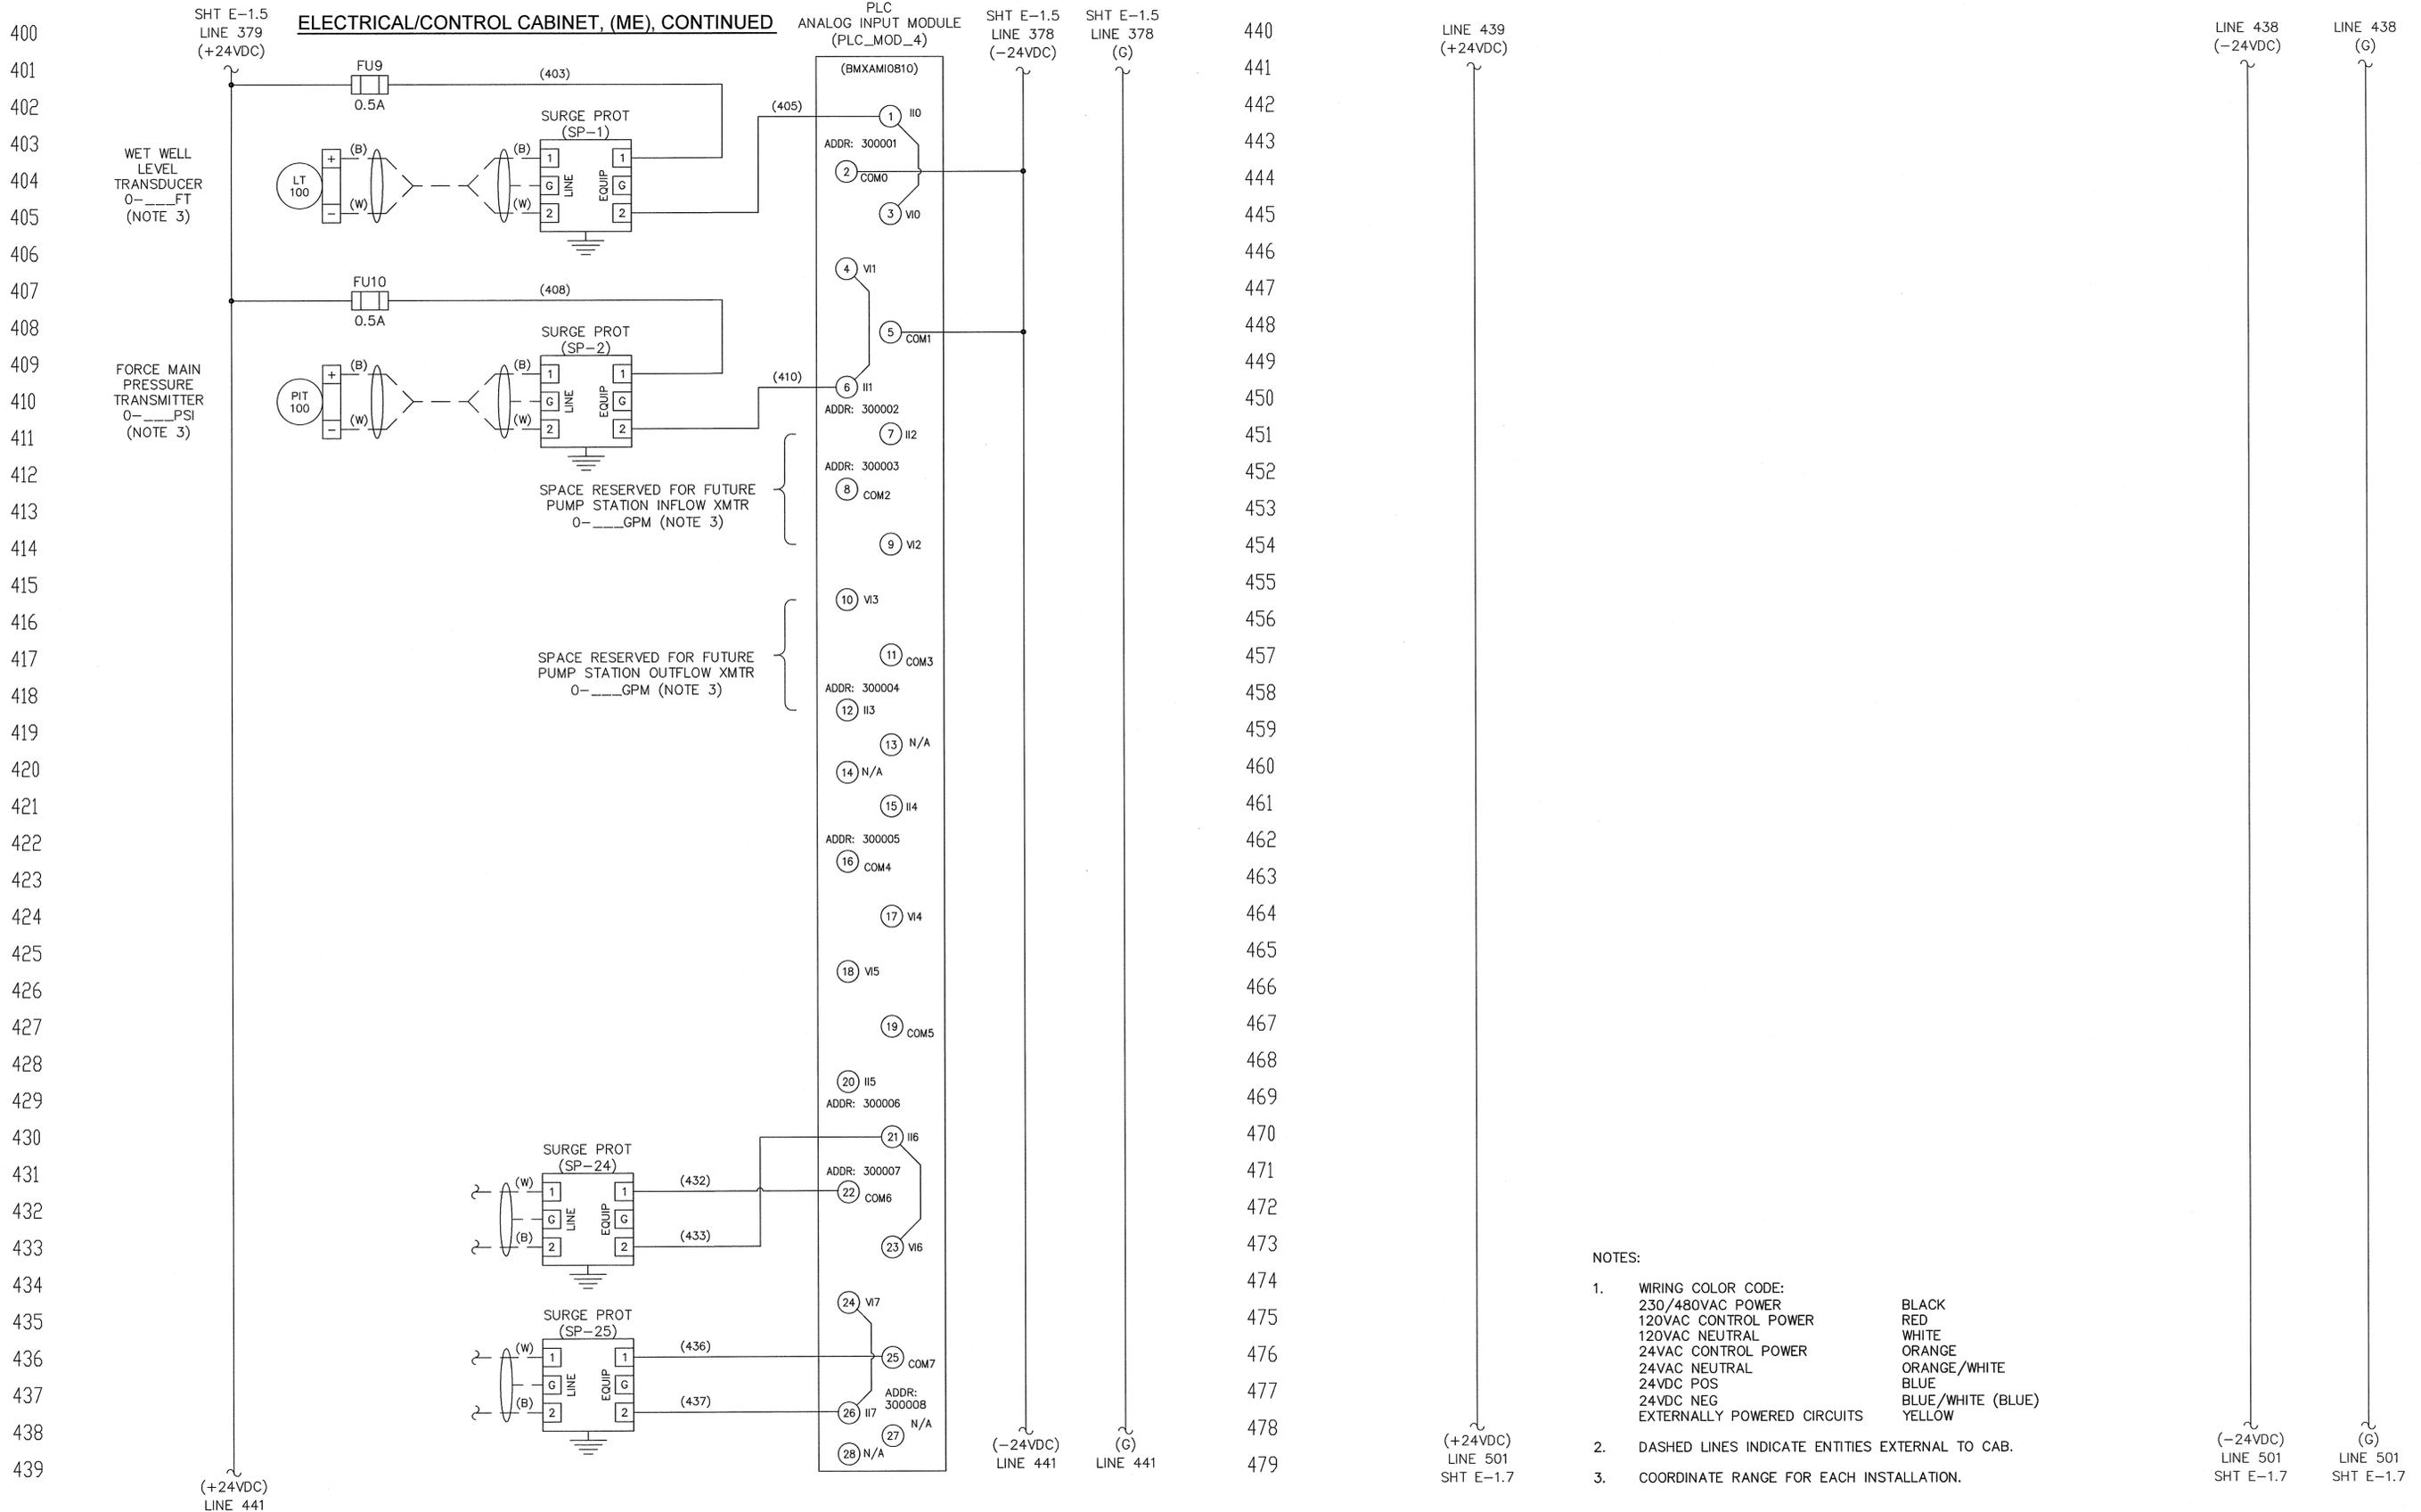

REV. NO.	DATE	DESCRIPTIONS
2	8/26/15	REVISED TO INCORPORATE FIELD CHANGES
1	5/17/13	CONFORMED
0		ISSUED

SEAL



SEAL

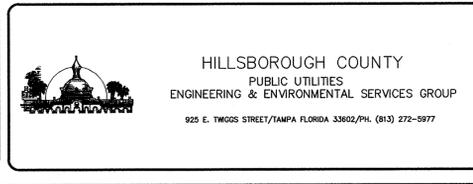





DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

ELECTRICAL/CONTROL ENCLOSURE
ELECTRICAL SCHEMATICS
(3PH)(480V/3-20HP)

DATE: OCTOBER 2011	SCALE	FILE NUMBER
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER
DRAWN	VERTICAL: NA	E-1.6
DESIGNED		
CHECKED		
PROJ. MGR.		
STATUS: REVISED		REVISION 2

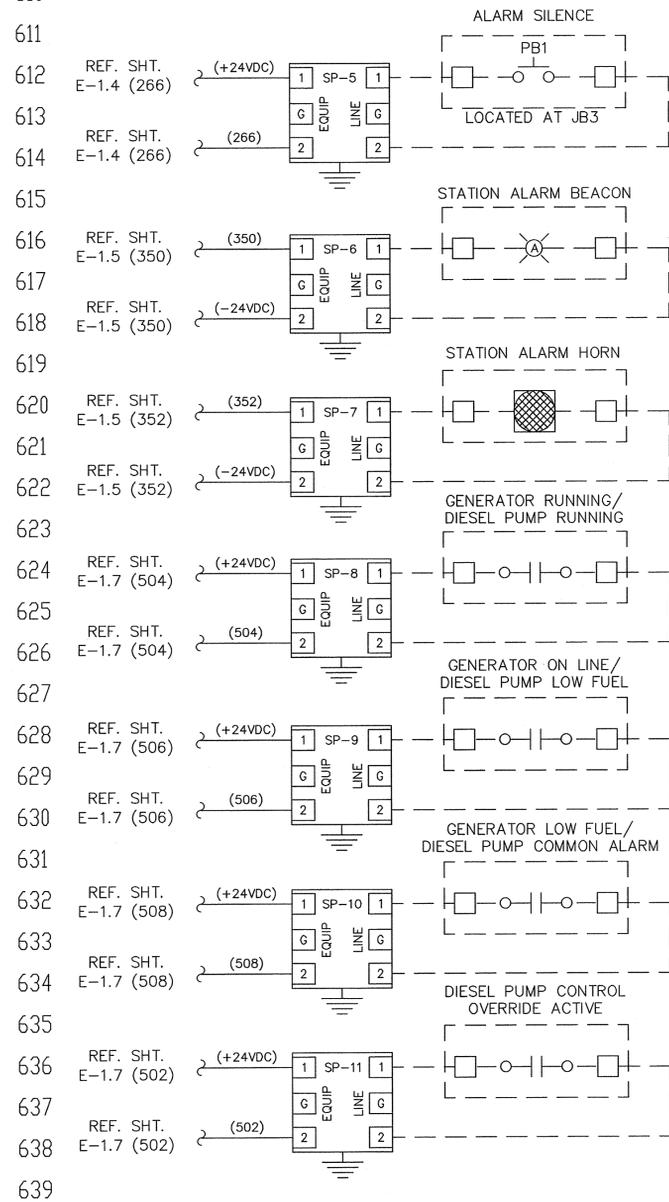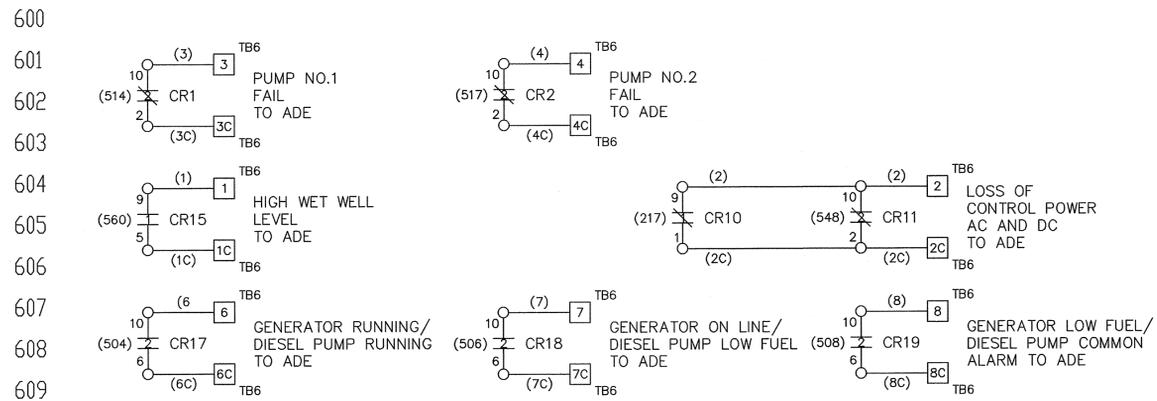





SHT E-1.7
LINE 576
(G)
640
641
642
643
644
645
646
647
648
649
650
651
652
653
654
655
656
657
658
659
660
661
662
663
664
665
666
667
668
669
670
671
672
673
674
675
676
677
678
679
(G)
LINE 641

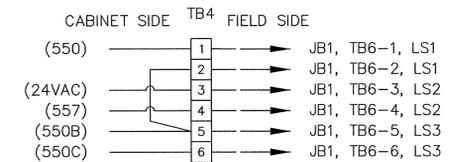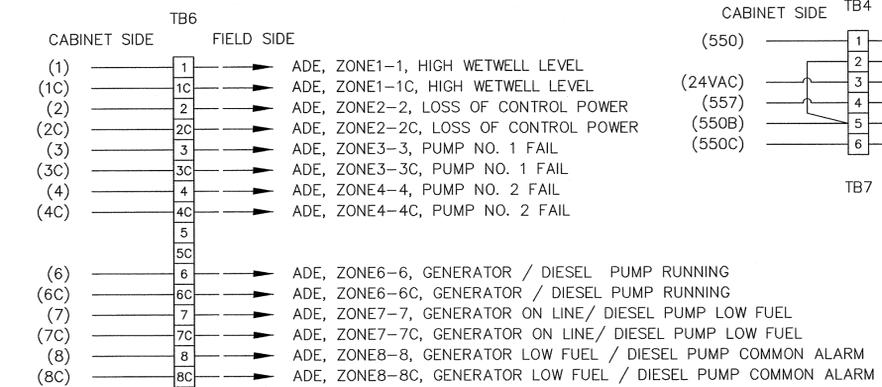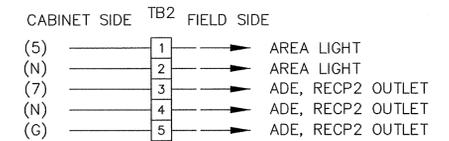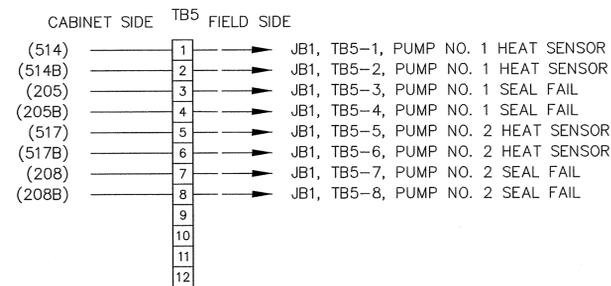

NOTES:

- WIRING COLOR CODE:
230/480VAC POWER BLACK
120VAC CONTROL POWER RED
120VAC NEUTRAL WHITE
24VAC CONTROL POWER ORANGE
24VAC NEUTRAL ORANGE/WHITE
24VDC POS BLUE
24VDC NEG BLUE/WHITE (BLUE)
EXTERNALLY POWERED CIRCUITS YELLOW
DASHED LINES INDICATE ENTITIES EXTERNAL TO CABINET.

REV. NO.	DESCRIPTIONS	DATE
2	REVISED TO INCORPORATE FIELD CHANGES	8/28/15
1	CONFORMED	5/17/13

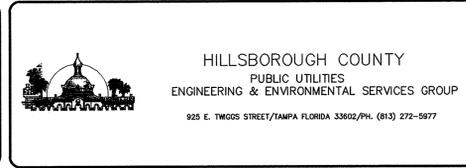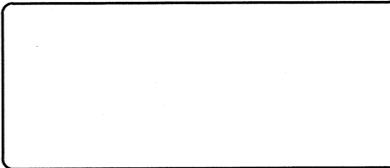


DUPLEX WASTEWATER PUMP STATION
ELECTRICAL, CONTROL & INSTRUMENTATION

ELECTRICAL/CONTROL ENCLOSURE
ELECTRICAL SCHEMATICS
(3PH)(480V/3-20HP)

DATE: OCTOBER 2011	SCALE	FILE NUMBER
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER
DESIGNED	VERTICAL: NA	E-1.8
CHECKED		
PROJ. MGR.		
STATUS: REVISED		REVISION 2

LIST OF MAJOR COMPONENTS					
ITEM NO.	QTY	DEVICE ID	MANUFACTURER	PART NO.	DESCRIPTION
ALARM SILENCE STATION:					
1	1		SQUARE-D	9001-KYSS100	JUNCTION BOX, 5"Hx4"Wx3.5"D, NEMA 4X, 304SS, SCREW COVER
2	1	PB1	SQUARE-D	9001 KR1BH5	PUSHBUTTON, FULL GUARD, N.O. CONTACTS

NAMEPLATE SCHEDULE				
N.P. NO.	QTY	PLATE COLOR/SIZE	LTR COLOR/SIZE	ENGRAVING (LINE1/LINE2/ETC.)
ALARM SILENCE STATION:				
A	1	BLK / 2.25" H x 2.25" W	WHT / 3/16"	ALARM/SILENCE

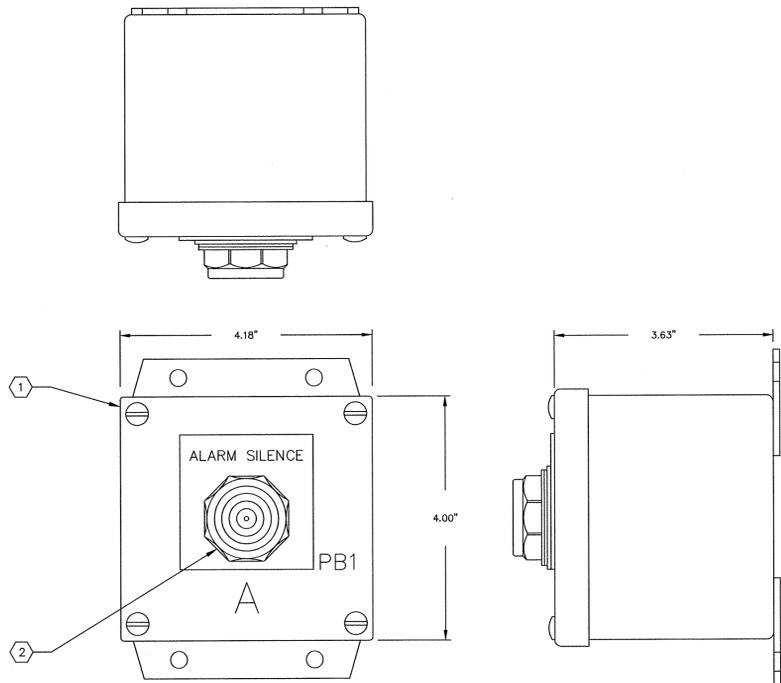



ALARM SILENCE STATION (JB-3)
3/4"=1"

NOTES:

- WIRING COLOR CODE:

240/480VAC POWER	BLACK
120VAC CONTROL POWER	RED
120VAC NEUTRAL	WHITE
24VDC POS	BLUE
24VDC NEG	BLUE/WHITE (BLUE)
EXTERNALLY POWERED CIRCUITS	YELLOW

REV. NO.	DESCRIPTIONS	DATE
2	REVISED, TO INCORPORATE FIELD CHANGES	9/28/15
1	CONFORMED	5/17/13

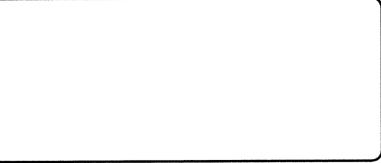



HILLSBOROUGH COUNTY
 PUBLIC UTILITIES
 ENGINEERING & ENVIRONMENTAL SERVICES GROUP
925 E. TWOGGS STREET/TAMPA FLORIDA 33602/PH. (813) 272-5977




ALARM SILENCE STATION
ENCLOSURE LAYOUT AND
BILL OF MATERIAL

DATE: OCTOBER 2011	SCALE:
PROJ. # 1179-0013	HORIZONTAL:
DRAWN:	VERTICAL: NA
DESIGNED:	
CHECKED:	
PROJ. MGR.:	
STATUS: REVISED	


FILE NUMBER	
DRAWING NUMBER	
	E-2.0
REVISION	2

LIST OF MAJOR COMPONENTS					
ITEM NO.	QTY	DEVICE ID	MANUFACTURER	PART NO.	DESCRIPTION
WET WELL JUNCTION BOX (JB1):					
1	1	JB1	HOFFMAN	A30H2410SSLP	ENCLOSURE, 30"Hx24"Wx10"D, NEMA 4X, 304SS, EPOXY WHITE FINISH
2	1		HOFFMAN	A30P24AL	SUBPANEL, 27"Hx21"W, 0.10" THICK, ALUMINUM
3	2	TB1, TB2, TB3*	MARATHON	1333554	POWER DISTRIBUTION BLK, 3 POLE, 310A, 600VAC, PRIM: 1 CONN 6-350 CU, SEC: 2 CONN 14-2/0 CU
FOR 230V/50HP AND 480V/100HP ONLY:					
2	2	TB1, TB2, TB3*	MARATHON	1333565	POWER DISTRIBUTION BLK, 3 POLE, 420A, 600VAC, PRIM: 1 CONN 2-600 CU, SEC: 2 CONN 6-250 CU
4	25	TB5, TB6, TB7	PHOENIX CONTACT	UKS-N	TERMINAL BLOCK
5	3		PHOENIX CONTACT	D-LKK3/5	TERMINAL BLOCK END BARRIER
6	6		PHOENIX CONTACT	1201442	TERMINAL BLOCK END STOP
7	AR		PHOENIX CONTACT		DIN RAIL

NAMEPLATE SCHEDULE				
N.P. NO.	QTY	PLATE COLOR/SIZE	LTR COLOR/SIZE	ENGRAVING (LINE 1/LINE 2/ETC.)
WET WELL JUNCTION BOX (JB1):				
A	1	BLK / 2.00" H x 6.00" W	WHT / 1/2"	JB1

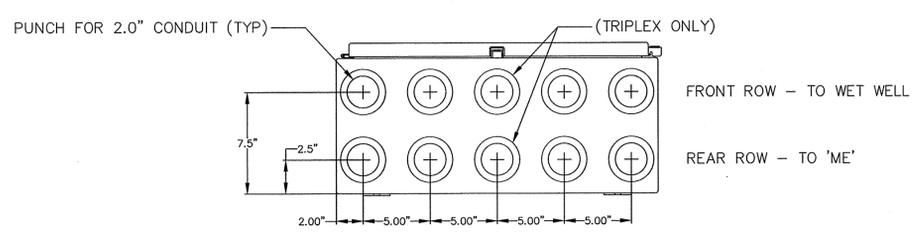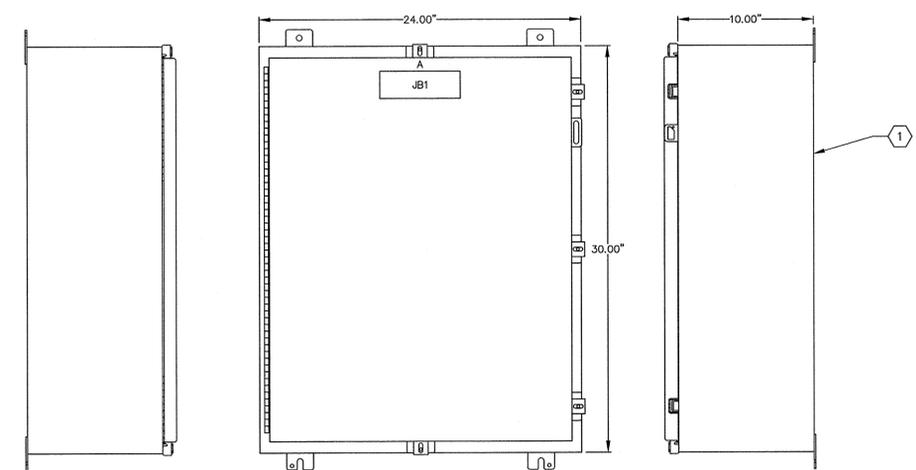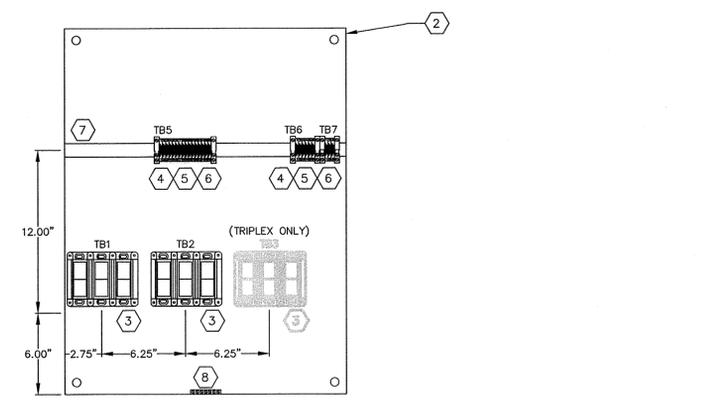

JB1 ENCLOSURE LAYOUT
2" = 1"

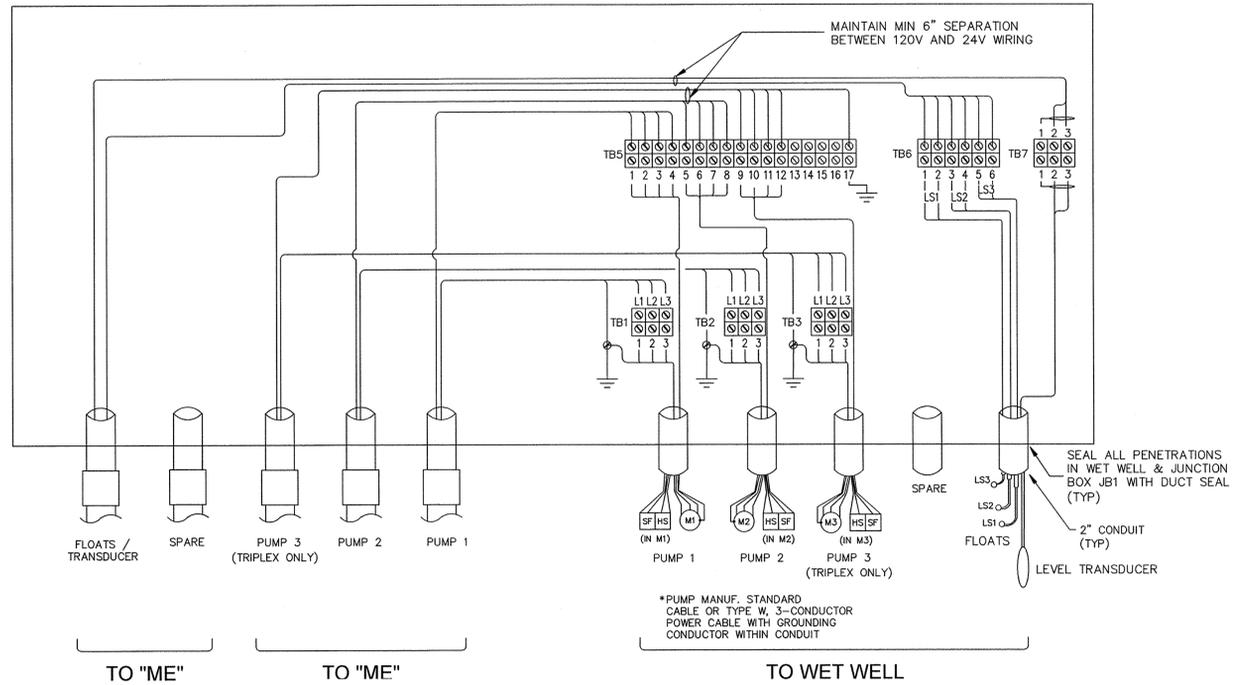

JB1 ELECTRICAL SCHEMATIC
NTS

- NOTES:**
1. APPLY OXIDE-INHIBITING COMPOUND TO ALL ELECTRICAL TERMINATION CONTACT SURFACES, INCLUDING COMPRESSION AND BOLTED CONNECTIONS. PENETROX COMPOUND BURNDY OR EQUAL PRODUCT.
 2. SCREW-DOWN CABLE TIES SHALL BE 3M CABLE TIE BASE MODEL 06299 OR PANDUIT MODEL ABM112 OR APPROVED EQUAL. (SIZE AS REQ'D)
 3. CONTRACTOR SHALL MOUNT TERMINALS AS SHOWN.

DESIGN BASIS NOTE:
THIS DRAWING REPRESENTS THE STANDARD DESIGN FOR ALL HILLSBOROUGH COUNTY STANDARD WASTEWATER PUMPING STATIONS. IT WAS DEVELOPED TO IMPROVE RELIABILITY AND MAINTAINABILITY, MINIMIZE SPARE PARTS AND INCREASE SERVICE LIFE. ALL REQUESTS FOR DEVIATION FROM THIS STANDARD MUST BE MADE IN WRITING AND WRITTEN APPROVAL RECEIVED BEFORE MODIFICATIONS ARE MADE. CONTRACTOR IS RESPONSIBLE FOR ALL COSTS NECESSARY TO RESTORE UNAUTHORIZED MODIFICATIONS.

DESIGN ENGINEER NOTE: *THIS IS NOT A CONSTRUCTION DRAWING*
DESIGN ENGINEER SHALL REFER TO ELECTRICAL DRAWINGS, MECHANICAL DRAWINGS, AND THE HILLSBOROUGH COUNTY WATER AND WASTEWATER TECHNICAL SPECIFICATION IN ORDER TO COORDINATE THE MECHANICAL AND ELECTRICAL INSTALLATIONS. DESIGN ENGINEER SHALL NOT USE THIS DRAWING FOR A SPECIFIC SITE INSTALLATION. FOR EACH INSTALLATION A SPECIFIC SET OF CONSTRUCTION DRAWINGS AND SPECIFICATIONS (IF DEEMED NECESSARY BY THE DESIGN ENGINEER) MUST BE PREPARED IN ACCORDANCE WITH F.S. 471 AND RULES 61G.

REV. NO.	CONFORMED	DESCRIPTIONS	DATE
2		REVISED TO INCORPORATE FIELD CHANGES	8/28/15
1		CONFORMED	5/7/15
1		CONFORMED	5/7/15

SEAL

SEAL


SEAL

WET WELL JUNCTION BOX, (JB1)
CABINET LAYOUT, ELECTRICAL SCHEMATIC, AND BILL OF MATERIAL


DATE: OCTOBER 2011	SCALE: HORIZONTAL	FILE NUMBER: NA
PROJ. # 1179-0013	VERTICAL: NA	DRAWING NUMBER: E-3.0
DRAWN: _____		
DESIGNED: _____		
CHECKED: _____		
PROJ. MGR: _____		
STATUS: REVISED		REVISION: 2

LIST OF MAJOR COMPONENTS					
ITEM NO.	QTY	DEVICE ID	MANUFACTURER	PART NO.	DESCRIPTION
AUTODIALER PANEL (ADE):					
1	1	ADE	STAHLIN	J1614HPL	ENCLOSURE, 16"Hx14"Wx6"D, NEMA 3R, FIBERGLASS, GREY
2	1		STAHLIN	BP1614AL	SUBPANEL, 16"Hx14"W, ALUMINUM
3	1	AD	PHONETICS, INC.	FGD-0800	ALARM DIALER, SENSAPHONE MODEL 800
4	1	RECP2	PHOENIX CONTACT	EM-DUO-120/15	RECEPTACLE BOX, 120VAC, DUPLEX, NON-GFI, 15A
5	AR		PANDUIT		WIRE DUCT, 1.00"Wx2.00"H
6	1	TLSP	PHOENIX CONTACT	DT-TELE-RJ45	TELEPHONE LINE SURGE PROTECTION, (RJ11, RJ12, RJ45 CONNECTIONS)

NAMEPLATE SCHEDULE				
N.P. NO.	QTY	PLATE COLOR/SIZE	LTR COLOR/SIZE	ENGRAVING (LINE1/LINE2/ETC.)
AUTODIALER PANEL (ADE):				
A	1	BLK / 2.00" H x 6.00" W	WHT / 1/2"	PNLADE



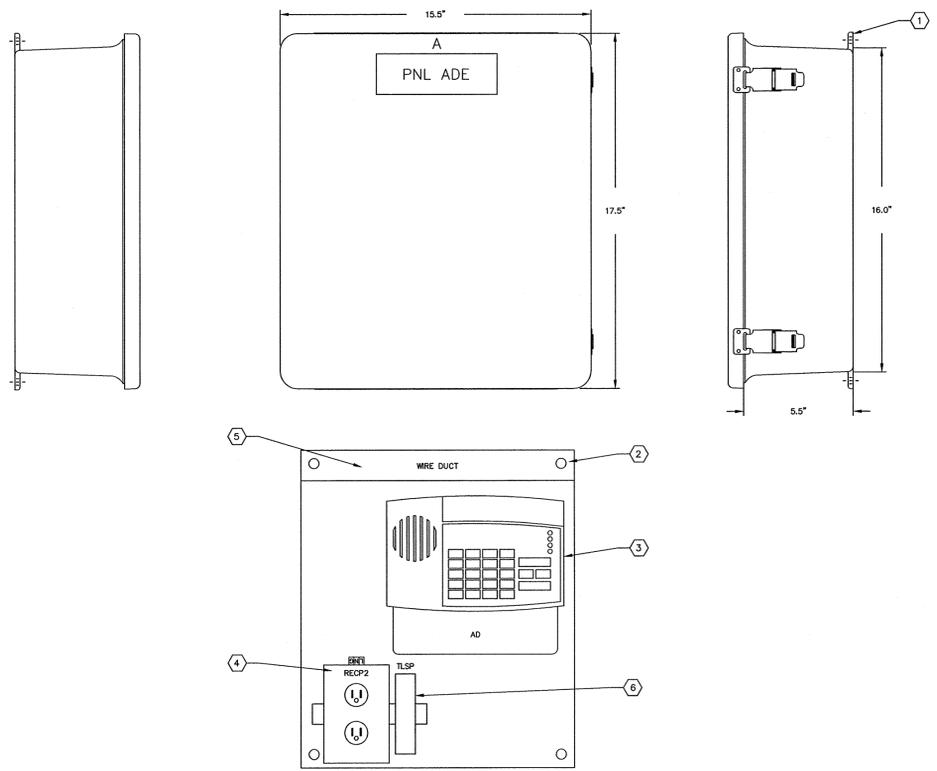


AUTODIALER PANEL (ADE)
1/4"=1"

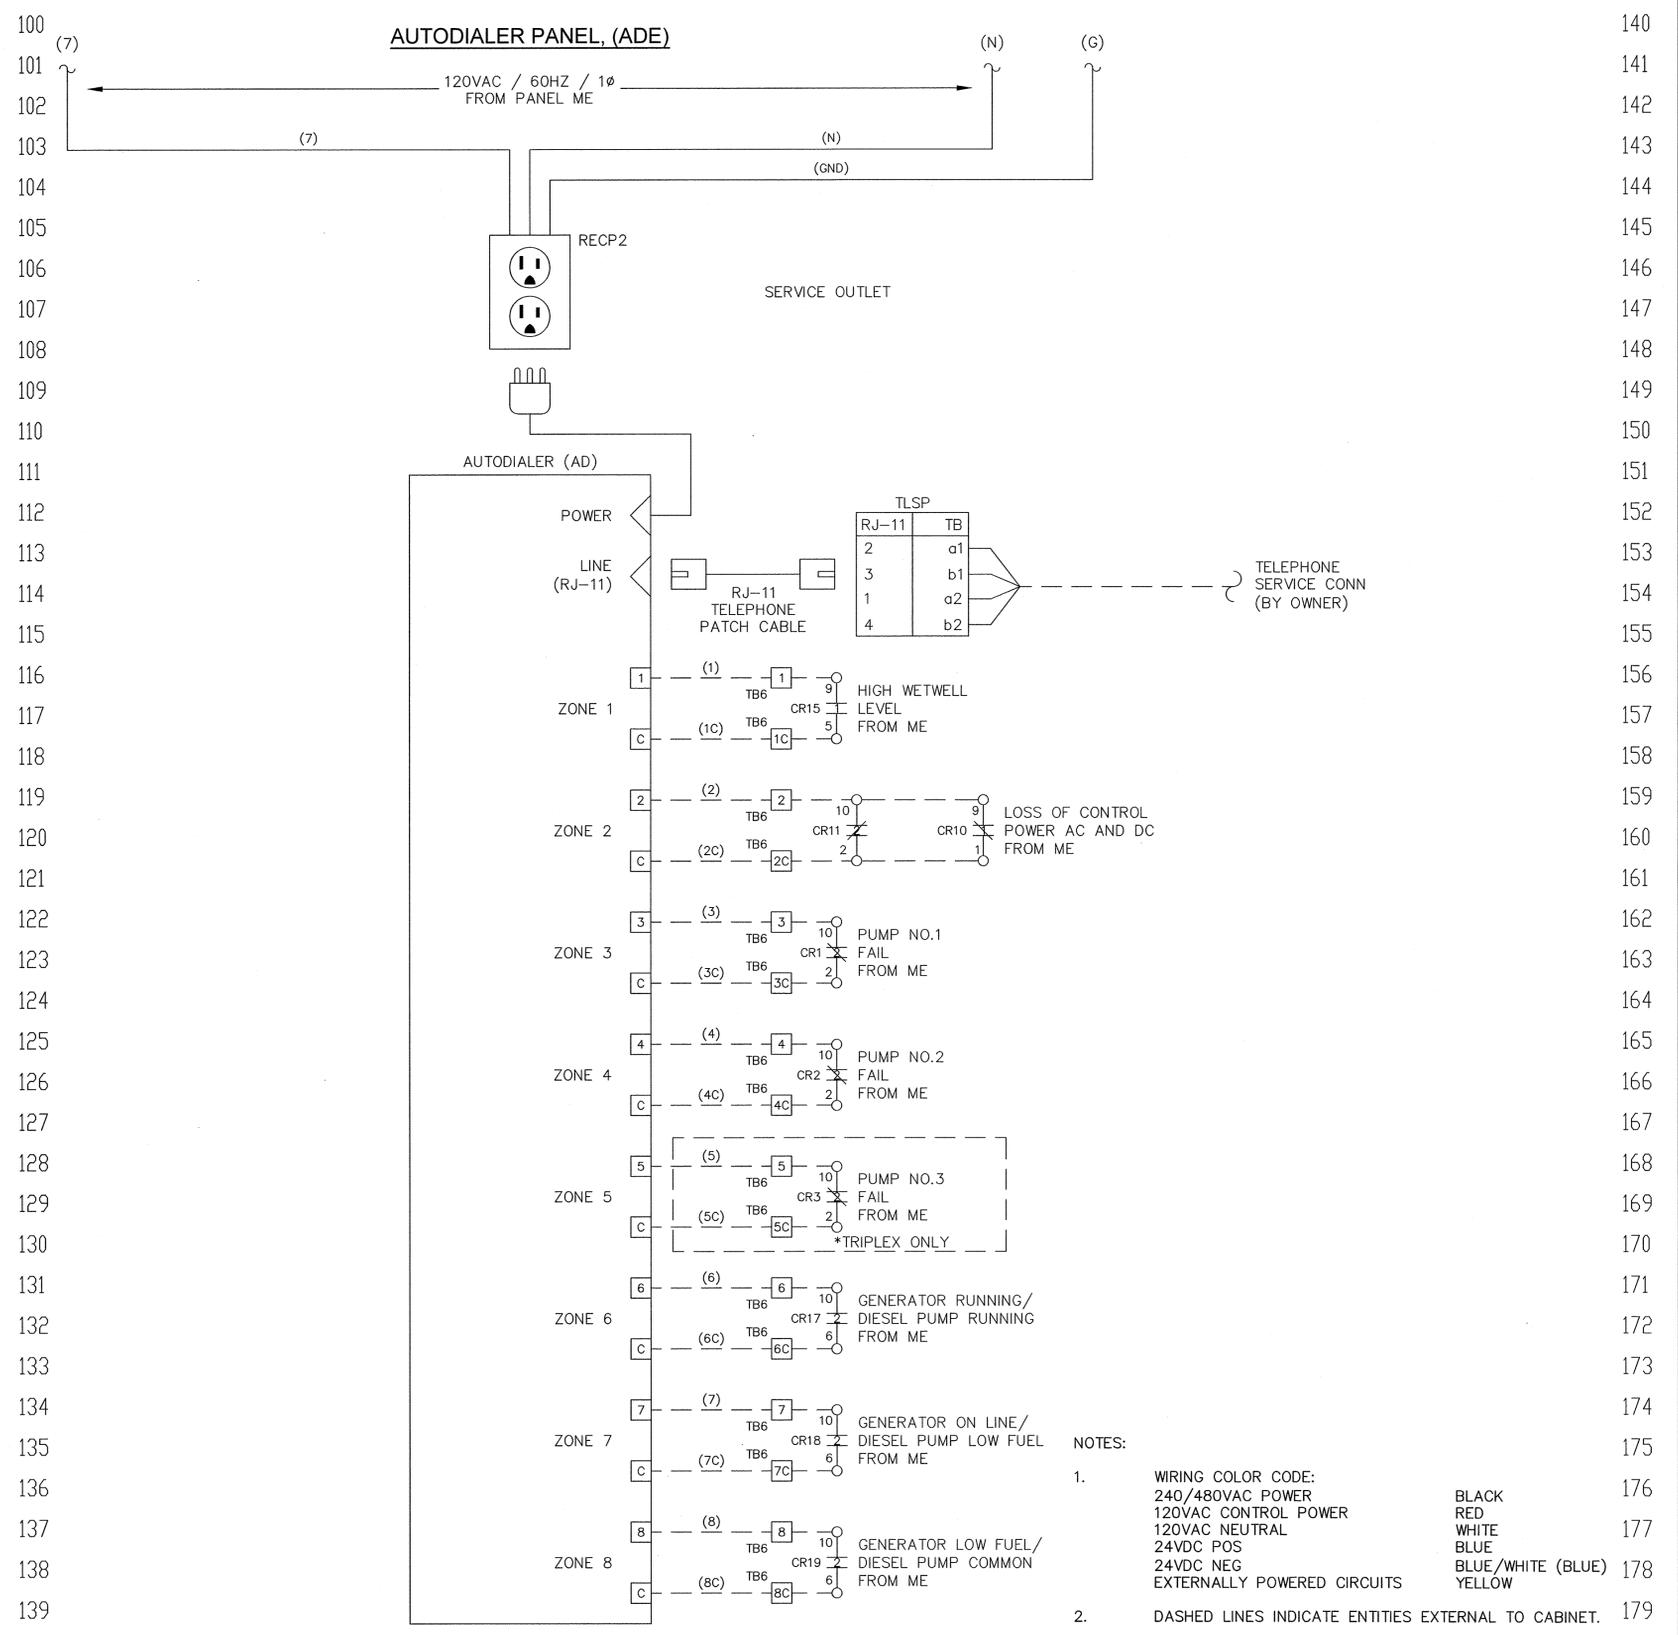

- NOTES:
- WIRING COLOR CODE:
 240/480VAC POWER BLACK
 120VAC CONTROL POWER RED
 120VAC NEUTRAL WHITE
 24VDC POS BLUE
 24VDC NEG BLUE/WHITE (BLUE)
 EXTERNALLY POWERED CIRCUITS YELLOW
 - DASHED LINES INDICATE ENTITIES EXTERNAL TO CABINET.





REV. NO.	DESCRIPTION	DATE
2	REVISED, TO INCORPORATE FIELD CHANGES	8/26/15
1	CONFORMED	5/17/13

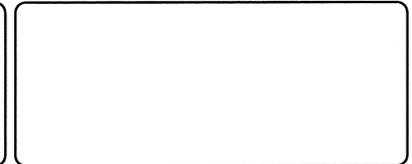

AUTODIALER ENCLOSURE, (ADE)
CABINET LAYOUT, ELECTRICAL SCHEMATIC, AND BILL OF MATERIAL

DATE: OCTOBER 2011	SCALE:	FILE NUMBER:
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER:
DRAWN:	VERTICAL:	E-4.0
DESIGNED:	NA	
CHECKED:		
PROJ. MGR.:		
STATUS: REVISED		REVISION 2

LIST OF MAJOR COMPONENTS					
ITEM NO.	QTY	DEVICE ID	MANUFACTURER	PART NO.	DESCRIPTION
GENERATOR TERMINATION BOX (JB4):					
1	1	JB4	HOFFMAN	A1614CHNFSS6	ENCLOSURE, 16"x14"x6"D, NEMA 4X, 304 SS, W/ LOCK KIT, EPOXY WHITE FINISH
2	1		HOFFMAN	A18P14SS	SUBPANEL, 14.75"x12.88"W, 304 SS, EPOXY WHITE FINISH
3	2		HOFFMAN	AS250SS	HOLE SEAL, 2.50", 300 SERIES SS, WEATHER-PROOF, EPOXY WHITE FINISH
4	5	PDB1,2,3,4,5	BUSSMANN	PDB204-1	POWER DISTRIBUTION BLK, 1 POLE, 175A, 600VAC, PRIM: 1 CONN 8-2/0 CU, SEC: 1 CONN 8-2/0 CU

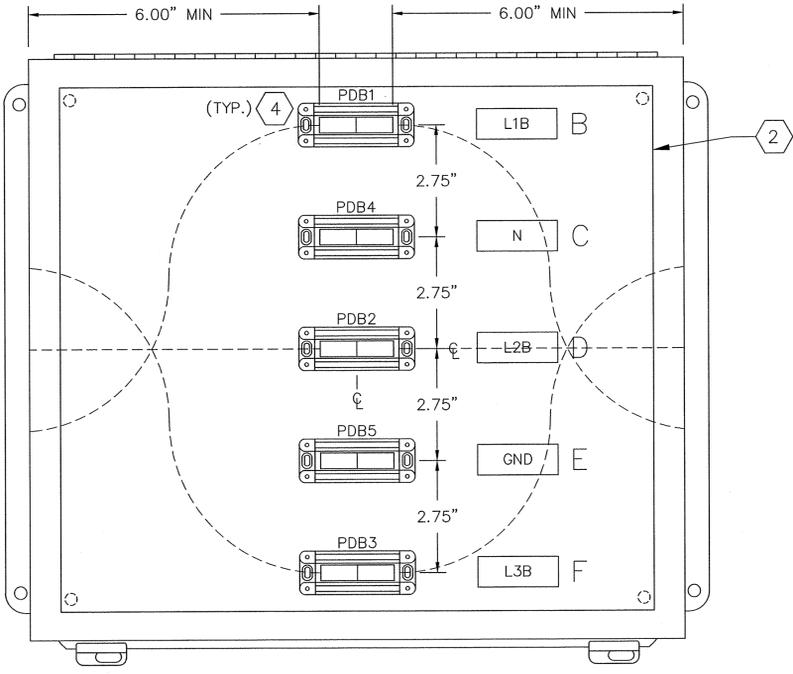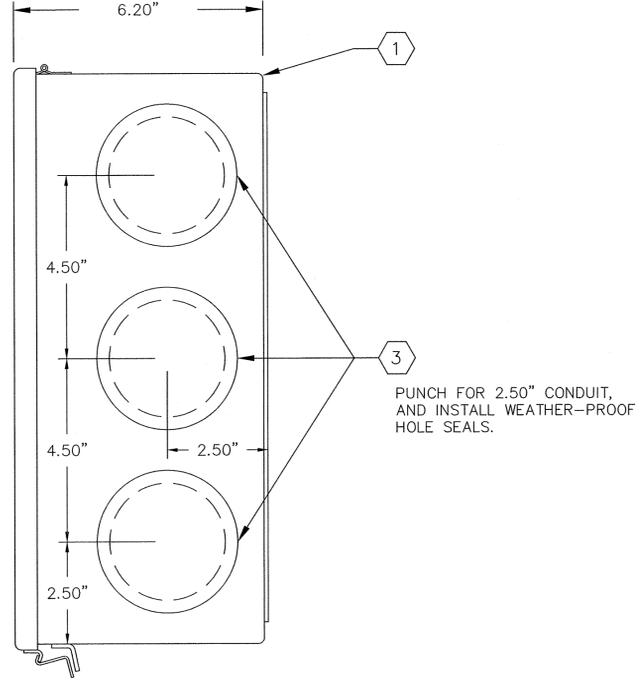
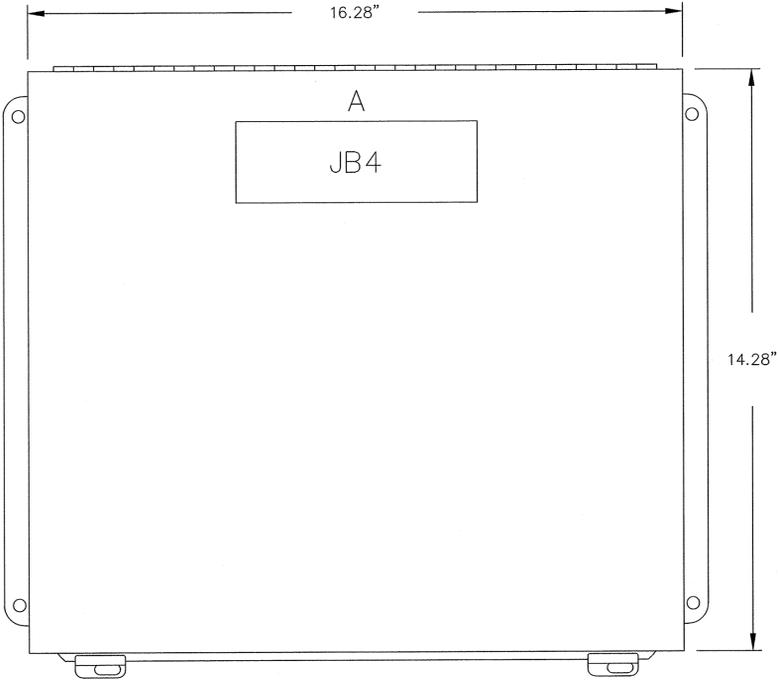
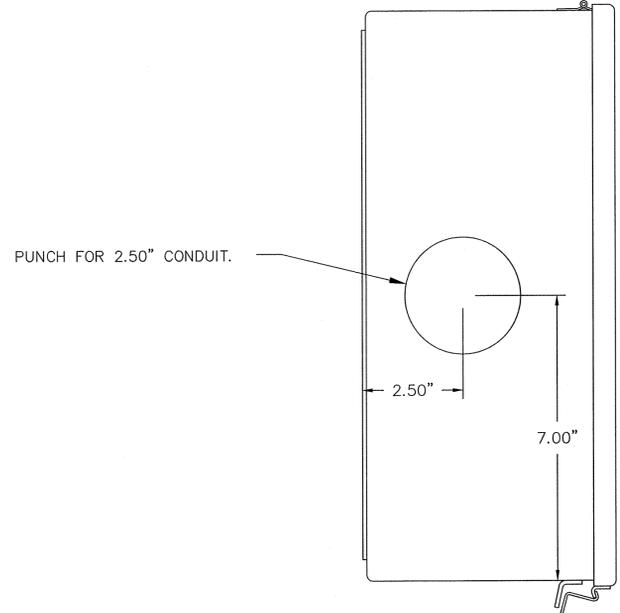


GENERATOR TERMINATION PANEL (JB4)
1/2"=1"

NAMEPLATE SCHEDULE			
N.P. NO.	QTY	PLATE COLOR/SIZE	ENGRAVING (LINE1/LINE2/ETC.)
GENERATOR TERMINATION BOX (JB4):			
A	1	BLK / 2.00" H x 6.00" W	WHT / 1/2" JB4
B	1	BLK / 0.75" H x 2.50" W	WHT / 1/4" L1B
C	1	BLK / 0.75" H x 2.50" W	WHT / 1/4" N
D	1	BLK / 0.75" H x 2.50" W	WHT / 1/4" L2B
E	1	BLK / 0.75" H x 2.50" W	WHT / 1/4" GND
F	1	BLK / 0.75" H x 2.50" W	WHT / 1/4" L3B

NOTE: FOR USE WITH THE FOLLOWING "ME" PACKAGES ONLY:
 - DUP, 3PH/480VAC/3-20HP
 - TRI, 3PH/480VAC/3-20HP

REV. NO.	DATE	DESCRIPTION
2	8/28/15	REVISED, TO INCORPORATE FIELD CHANGES
1	5/17/13	CONFORMED
1		

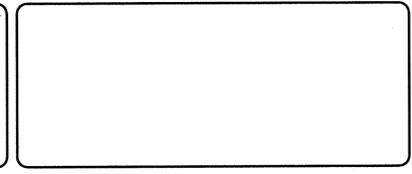

HILLSBOROUGH COUNTY
 PUBLIC UTILITIES
 ENGINEERING & ENVIRONMENTAL SERVICES GROUP
 925 E. TWINN STREET/TAMPA, FLORIDA 33602/PH. (813) 272-5977

GENERATOR TERMINATION BOX, JB4 (SMALL)
CABINET LAYOUT AND BILL OF MATERIAL

DATE: OCTOBER 2011	SCALE:	FILE NUMBER:
PROJ. # 1179-0013	HORIZONTAL:	DRAWING NUMBER:
DRAWN:	VERTICAL: NA	E-5.0
DESIGNED:		
CHECKED:		
PROJ. MGR.:		
STATUS: REVISED		REVISION: 2