


VALLEY GUTTER
SECTION A - A

NOTES:

1. Concrete to be Class I, minimum 28 Day compressive strength of 3000 psi

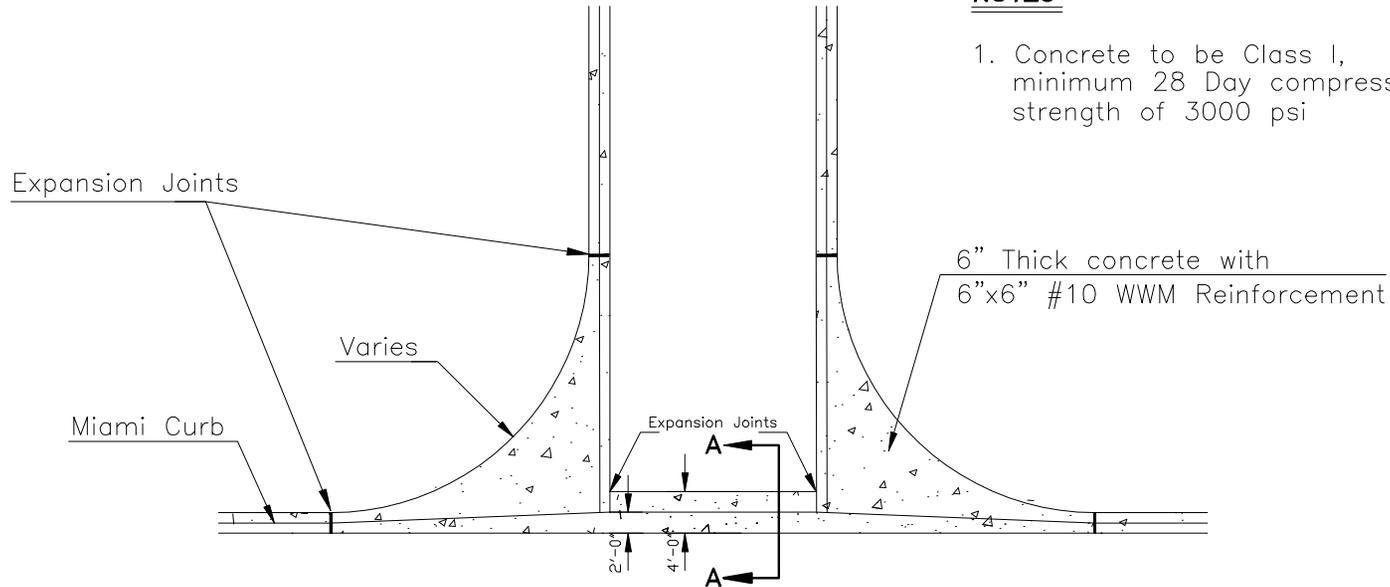

REVISION DATE :

**TRANSPORTATION TECHNICAL
MANUAL**



**INTERSECTION VALLEY GUTTER
TYPICAL DETAILS**

DRAWING NO. TD-6

SHEET NO. 1 OF 1