


FOR ALL PRIVATE AND PUBLIC RESIDENTIAL DEVELOPMENT WITH GUARDBOUSES OR ELECTRONIC ENTRANCES

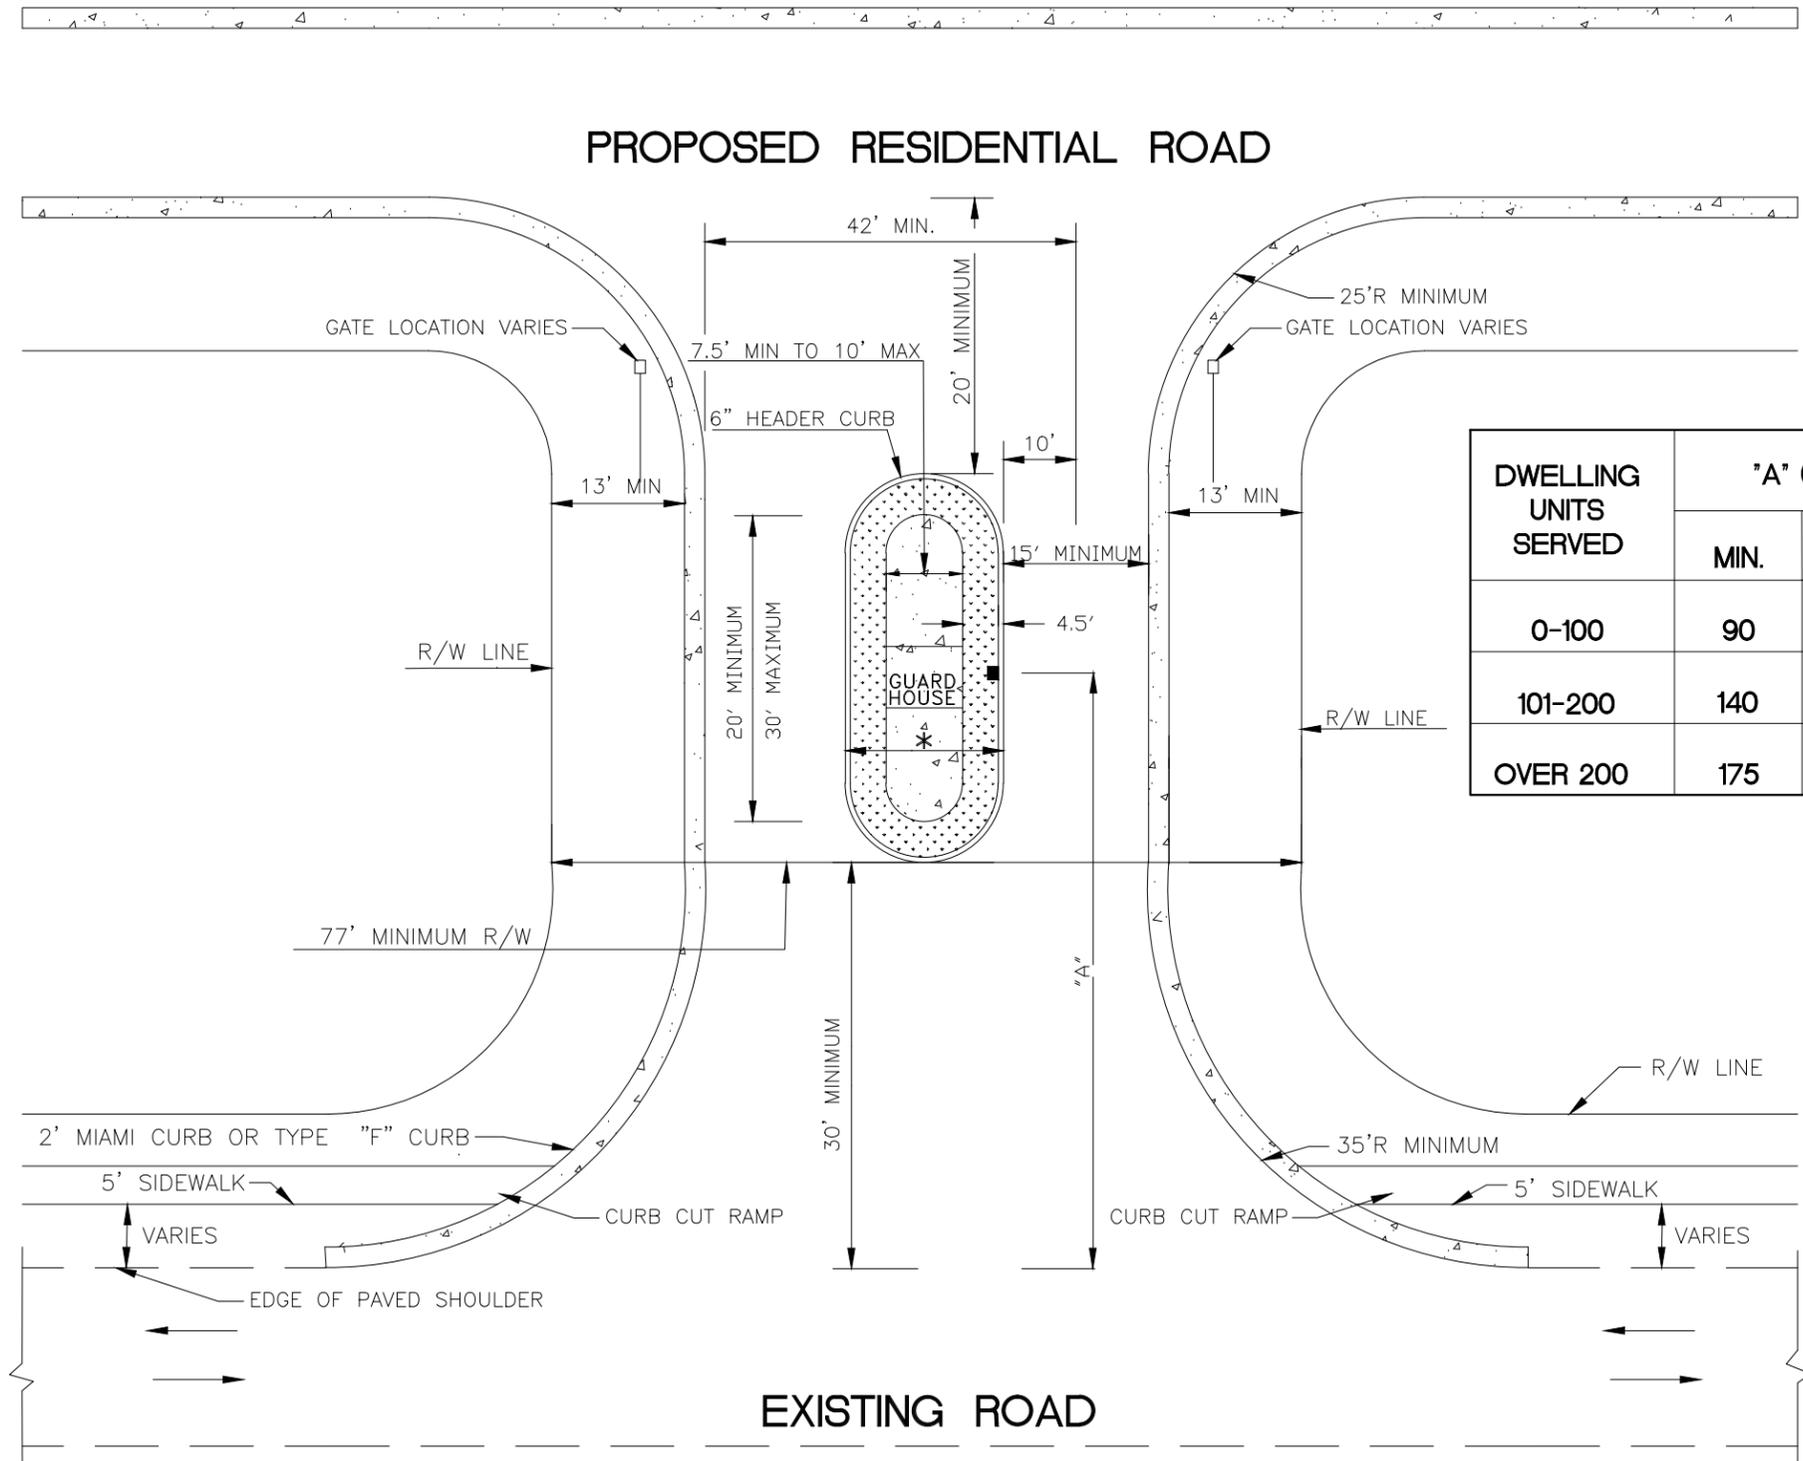

| DWELLING UNITS SERVED | "A" (Ft.) | |
|-----------------------|-----------|------|
| | MIN. | MAX. |
| 0-100 | 90 | 140 |
| 101-200 | 140 | 190 |
| OVER 200 | 175 | 225 |

FOR PUBLIC RESIDENTIAL DEVELOPMENTS

1. Guardhouse shall not overhang in County right of way.
- 2.* Minimum width of median containing a guardhouse shall be 16.5'. Minimum width of median without a guardhouse shall be 10'.
3. Gates, if installed, are to be for ornamental purposes only, shall be fixed in open position and shall not be located within the clear zone area.
4. Gates which close, whether automated or manned shall be allowed only on privately maintained roads.

PRIVATE GATED DEVELOPMENTS

1. Private gated developments shall provide adequate space for a single unit 30-foot truck to make a U-Turn. This minimum outside distance is 42'. This U-Turn area shall be between the electronic entrance device and entrance gate.
2. The distance "A" in the table shall be measured from the stop bar at the guardhouse or from the electronic entry devices, inclusive of any entry control features.
- 3.* Minimum width of median for the Electronic Entry Device is 4 feet.

REVISION DATE :
10/15

**TRANSPORTATION TECHNICAL
MANUAL**



**ENTRANCE MEDIAN, GUARDBOUSE
AND ELECTRONIC ENTRY
TYPICAL DETAILS**

DRAWING NO. TD-9
SHEET NO. 1 OF 1